

Sensors & Controls

# **x/e-touch**PANEL 02

Manual



**TRIDONIC**

# Table of Contents

<b>1. Validity</b>	<b>4</b>
1.1. Copyright	4
1.2. Imprint	4
<b>2. Safety instructions</b>	<b>4</b>
2.1. Designated use	5
2.2. Dangers associated with the operation of the system	5
<b>3. About the device</b>	<b>6</b>
3.1. Operation	6
3.2. Used software	6
3.3. Different settings	6
3.4. DALI control system	7
<b>4. Basic Settings</b>	<b>8</b>
4.1. Overview of the basic settings	8
4.2. Configuring the basic settings	10
<b>5. Emergency Application</b>	<b>17</b>
5.1. Overview	17
5.2. Settings for Emergency Application	20
5.3. DALI communication test	22
5.4. Addressing and grouping emergency units	23
5.5. Programming the prolong time	27
5.6. Configuring the error signalling	28
5.7. Identifying emergency units	31
5.8. Manually testing emergency units	32
5.9. Determining the starting time for automated testing	35
5.10. Set up eMail function	38
5.11. Deactivating emergency units	39
<b>6. Basic, Colour, Plug Application</b>	<b>41</b>
6.1. Overview	41
6.2. Settings for DALI Applications	48
6.3. Basic Application	54
6.4. Colour Application	69
6.5. Plug Application	74
6.6. Operation in the Home menu	75
<b>7. Interfaces</b>	<b>85</b>
7.1. Loading the software update	85
7.2. Overview	86

## Table of Contents

7.3. USB interface .....	87
7.4. Ethernet interface .....	97
7.5. Uploading / downloading files and test protocols .....	100
<b>8. Appendix</b> 111	
8.1. Technical data .....	111
8.2. Circuit diagrams .....	112
8.3. Schedule for Ethernet connections .....	113
8.4. Help in the case of problems .....	115
8.5. Reference list .....	116

## Scope of documentation

This operating instruction is valid for the DALI control system x/e-touchPANEL 02.

TRIDONIC GmbH & Co KG is constantly striving to develop all its products. This means that there may be changes in form, equipment and technology.

Claims cannot therefore be made on the basis of information, diagrams or descriptions in these instructions.

The latest version of these operating instructions is available on our home page at

<http://www.tridonic.com/com/en/operating-instructions.asp>

### NOTICE

#### Software updates



The software for the x/e-touchPANEL 02 is continuously developed and improved. Software updates are provided to our customers free of charge.

To make sure that you always use the latest software version, you can register at [www.tridonic.com/xe](http://www.tridonic.com/xe).

As a registered user you will be notified by email whenever a new update is available.

To register, follow the link [www.tridonic.com/xe](http://www.tridonic.com/xe) or scan the QR code with your smartphone.

## 1.1. Copyright

This documentation may not be changed, expanded, copied or passed to third parties without the prior written agreement of TRIDONIC GmbH & Co KG.

We are always open to comments, corrections and requests. Please send them to [info@tridonic.com](mailto:info@tridonic.com)

## 1.2. Imprint

Tridonic GmbH & Co KG  
Färbergasse 15  
6851 Dornbirn  
Austria  
T +43 5572 395-0  
F +43 5572 20176  
[www.tridonic.com](http://www.tridonic.com)

The instructions in this section have been compiled to ensure that operators and users of DALI control system x/e-touchPANEL 02 from Tridonic are able to detect potential risks in good time and take the necessary preventative measures.

- \_ This device may only be installed and configured by suitably qualified personnel.
- \_ Every operator must read these operating instructions carefully and comply with the instructions contained therein.
- \_ The operator must ensure that all users fully understand these instructions and adhere to them.

## Safety instructions

### 2.1. Designated use

The x/e-touchPANEL can be used for the following applications:

For controlling DALI emergency lighting systems in Emergency operating mode or controlling DALI lighting systems in the Basic, Colour or Plug operating mode.

#### 2.1.1. Designated use with Emergency Application

The x/e-touchPANEL in Emergency Application may only be used for controlling the emergency lighting of single battery powered emergency lighting systems. It can control a maximum of 120 emergency units.

Only the following emergency lighting modules may be connected:

- \_ EM PRO
- \_ EM powerLED PRO

#### 2.1.2. Designated use with Basic, Colour or Plug DALI Application

The x/e-touchPANEL with Basic, Colour or Plug Application may only be used for commissioning and operating DALI lighting systems. The x/e-touchPANEL contains two DALI lines and can be connected to a maximum of 128 DALI operating devices.

Only the following operating devices may be connected:

- \_ Operating devices with a DALI interface

### 2.2. Dangers associated with the operation of the system

- \_ The owner must ensure that the wiring instructions and specifications for DALI lines are observed.
- \_ Touching the display with a sharp-edged object can result in damage to the display

The following safety instructions must additionally be observed when using the x/e-touchPANEL for controlling emergency lighting systems:

- \_ The owner must ensure that the country-specific regulations and standards for emergency lighting systems are observed.
- \_ x/e-touchPANEL may only be operated by a trained person who has been authorized by the owner and who has the professional training and knowledge, especially of the relevant regulations, to be able to assess the tasks he or she has been assigned as well as possible dangers.
- \_ The owner of the emergency lighting system must ensure that no one but authorized trained persons modify any settings of the x/e-touchPANEL.

## About the device

### 3.1. Operation

The x/e-touchPANEL can be operated in two different ways:

- \_ via the integrated touchpanel
- \_ via a PC (which must be connected to the x/e-touchPANEL)

The operation differs as follows:

- \_ The integrated touchpanel is operated by touching the touchscreen with a finger
- \_ The PC is operated with a keyboard or a mouse (which must be connected to the PC)

The connection between PC and the x/e-touchPANEL is done via [Ethernet interface](#), p. 97.

### 3.2. Used software

The x/e-touchPANEL is run by an integrated software called "xetouch". A combination with control gear of the comfortDIM series is possible.

#### 3.2.1. Used navigational symbols

For navigation within the software different symbols are used. Which symbols are displayed depends on the selected settings.

The most important symbols are explained below:

Symbol	Naming
	Home menu
	Main menu
	"Time & Date" menu
	Previous page and next page

### 3.3. Different settings

Prior to commissioning the x/e-touchPANEL the basic settings must be configured.

Other follow-up settings differ, depending on which Application has been chosen:

- \_ Emergency Application

## About the device

- \_ Basic, Colour, Plug Application

The basic settings and the different settings for these Applications are therefore covered in separate chapters.

### 3.4. DALI control system

The x/e-touchPANEL is a DALI control system and uses the DALI communication standard.

The most important aspects are summarized below:

DALI (Digital Addressable Lighting Interface) is a standardised digital protocol according to IEC 62386 for flexible room-related light management.

A maximum of 64 DALI operating devices can be assigned to up to 16 individually controllable light groups in a DALI line. One or several DALI lines can be connected via controllers.

DALI provides the system programmer with a set of commands that facilitates targeted programming without any special knowledge of lighting technology:

- \_ Control line polarity does not need to be observed
- \_ Use of standard cables
- \_ Fail-safe transmission due to digital technology

DALI also offers the following additional advantages compared with analog technology:

- \_ Each individual DALI operating device can be activated individually.
- \_ DALI operating devices can be assigned to several groups simultaneously.
- \_ Scene lighting and grouping are saved in the DALI operating device.
- \_ Special settings such as the speed of colour change (fading) and net recovery behaviour are possible.
- \_ When individual scenes are activated, all DALI operating devices reach their dimming value simultaneously.
- \_ The potential dimming range depends on the DALI operating device used and is between 0.1 and 100%.

## Basic Settings

### 4.1. Overview of the basic settings

The following table gives an overview of the basic settings of the x/e-touchPANEL. These are located in the "Configuration" menu as tabs at the top of the page.

Tab	Entry	Function
Display	Language	Set the language.
	Design	Set the touchscreen design (Only in the Basic, Colour and Plug Application)
	Clean	Briefly lock the touchscreen for cleaning.
	Frame light	Define the function of the frame light
	Beep on touch	Activate or deactivate the sound when touching the display
	Locking the configuration	Lock or release the user interface in the Home menu
	Screen saver	Activate or deactivate the screen saver.
	Locking the display	Locking of releasing the touchscreen (password protected).
System	Program version	Displays the »x-touch« software version
	Device name	Enter the name for the x/e-touchPANEL (For identification when several devices are used).
	Reset to factory defaults	Reset the settings to the factory defaults, e.g. Layout,
	Net recovery action	Control the behaviour after the power supply is interrupted
	Application	Select the Application.
	DALI Routing	Allows to send commands from other controls (e.g. DALI XC, TOUCHPANEL 02) from DALI line A to line B and vice versa. This Function can be activated or deactivated.  DAP commands will be forwarded on address, group and Broadcast level. Scene commands will only be forwarded on Broadcast level.
	DALI Numbering	Numbering from A1...A64 or A0...A63
TCP / IP	MAC	Displays the MAC address of the x/e-touchPANEL
	Use DHCP	Enables the assignment of the network configuration to clients by a server.

## Basic Settings

IP address	Entering the IP address (for the Ethernet connection).
Subnet mask	Entering the net mask (for the Ethernet connection).
Gateway	Entering the gateway (for the Ethernet connection).
Status	Displays the connection status.

### NOTICE

In addition to the tabs mentioned here, there are three more. But these are not available in all Applications:

- "Name" and "Layout" are available only in Basic, Colour, Plug Application
- "Emergency" is only available in Emergency application.

These three tabs / basic settings are discussed in the corresponding Application chapters.

## Basic Settings

### 4.2. Configuring the basic settings


#### 4.2.1. Selecting the language

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Click on the arrow key next to the Language entry.  
-> The list of languages is displayed.
4. Click on the desired language.  
-> The software interface is displayed in the selected language.

#### 4.2.2. Selecting the application


To call up another Application to the one currently being used:

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Select the System tab.  
-> The System tab is displayed:

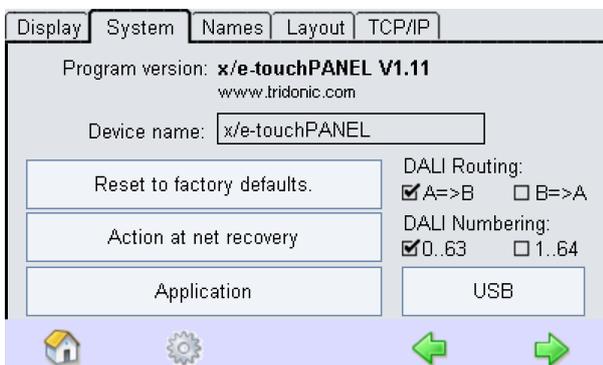

4. Select the Application.  
-> The dialog box Application is displayed:

## Basic Settings

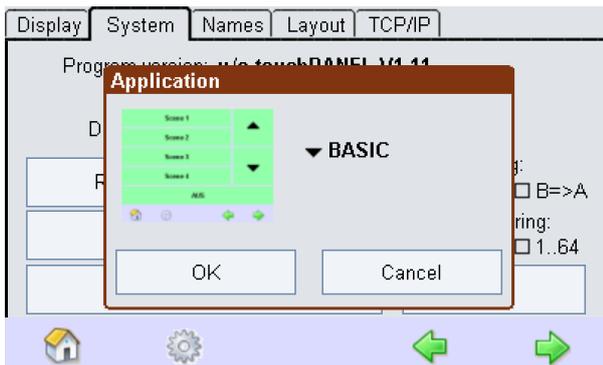

5. Select the Basic, Colour or Plug Application for the DALI operating modes or Emergency for controlling the emergency lighting in the dropdown menu.
6. Confirm the selection with OK.  
-> A dialog box is displayed indicating that a restart is essential depending on the Application selected.
7. Confirm the request with OK.  
-> A restart of the x/e-touchPANEL is performed depending on the Application.

### 4.2.3. DALI Routing

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Select the System tab.  
-> The System tab is displayed



Allows to send commands from other controls (e.g. DALI XC, TOUCHPANEL 02) from DALI line A to line B and vice versa.  
This Function can be activated or deactivated.

#### **i** NOTICE

DAP commands will be forwarded on address, group and Broadcast level.  
Scene commands will only be forwarded on Broadcast level.

## Basic Settings

### 4.2.4. Setting the time and date

Setting the time and date is necessary for time-controlled actions and for the frame light.

#### **i** NOTICE

The x/e-touchPANEL is supplied by a back-up battery for up to 3 days in the event of a power failure. If no voltage is supplied to the x/e-touchPANEL for a longer period of time, a dialog box indicates that the time and date must be entered again after the restart.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Time & date" symbol in the Main menu.  
-> The dialog box Time & Date is displayed.



3. Use the arrow keys to set the time and date and confirm with OK.
4. If the time is to be set automatically to summer or winter time, click on the arrow key below the Summer/Wintertime Changeover and select the time zone in which the device is located.
5. Confirm the settings with OK

### 4.2.5. Cleaning the touchscreen

The touchscreen can be temporarily disabled for cleaning to avoid accidentally changing settings. The cleaning is also possible without a password in case the configuration was disabled.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Click on the Clean button.  
-> The touchscreen is deactivated for 20 seconds. The remaining time is indicated.

## Basic Settings

4. Clean the touchscreen with a soft, damp cloth.

### 4.2.6. Setting the touchscreen

Set the user interface to your requirements in the Display tab.

#### NOTICE

It is possible to load an application-specific screen saver (see "Loading application-specific screen saver, p. 84").

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. To activate a confirmation beep to be generated whenever buttons are clicked, activate the "Beep on touch" check box.
4. Activate the "Screen saver" check box to switch on the screen saver. When the screen saver is activated, it is displayed two minutes after the touchscreen has been touched last.

### 4.2.7. Password protection

Access can be limited to two levels by assigning a password.

- \_ Locking the configuration: The "Home" menu is freely accessible for operating the system. The configuration of the buttons and the Main menu are password protected.
- \_ Locking the panel: The entire touchscreen is password protected

#### Locking the configuration

#### NOTICE

Ensure that you switch to the Home menu after locking the configuration. The password protection is only effective at this point.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Activate the "Lock configuration" check box.  
-> The password protection is set (factory default 1234). A dialog box is displayed to change the password.
4. In order to change the password, click on Yes and enter the old password in the following dialog box.

## Basic Settings

5. Enter the new password in the following two boxes and confirm with OK in each case.
6. Click on No if the password is not being changed.
7. Click on the Home menu to activate the password protection. The Main menu can only be opened once the password is entered.

### Locking the panel

#### **i** NOTICE

Ensure that the screen saver is displayed after the entire touchscreen is locked. The password protection is only effective at this point.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Activate the "Screen saver" and "Lock display" check boxes to lock the operation of the entire touchscreen. The password protection is set (factory default ›5678‹). A dialog box is displayed to change the password.
4. In order to change the password, click on Yes and enter the old password in the following dialog box. Enter the new password in the following two boxes and confirm with OK in each case.
5. Click on No if the password is not being changed. The touchpanel can only be operated once the password is entered after the screen saver is displayed.


### 4.2.8. Net recovery behaviour

The behaviour of the system after a power failure is defined in the Configuration menu.

Function	Net recovery action
No action	Sends no commands
Broadcast OFF	Switches off all operating devices.
Broadcast MAX	Sets all operating devices to maximum luminosity. Somfy components are moved upwards..
Broadcast MIN	Sets dimmed operating devices to the stored dimming value and all others to maximum luminosity. Somfy components are moved downwards.
Start Scheduler	Starts scheduler. A sequence is restarted; the schedule and schedule list are continued.

## Basic Settings

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "System" tab  
-> The "System" tab is displayed
4. Click on the "Action at net recovery" button.  
-> The dialog box Net recovery action is displayed.

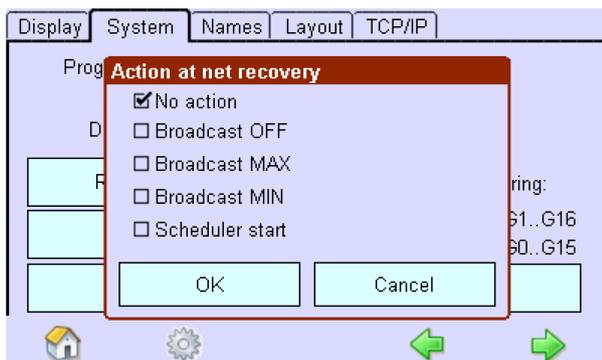


5. Activate the check box and confirm with OK.

## Basic Settings

### 4.2.9. Determining device names and the program version

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "System" tab  
-> The "System" tab is displayed  
-> The device name and program version are displayed.
4. Click on the device name to change the device name.  
-> The dialog box Keyboard is displayed.

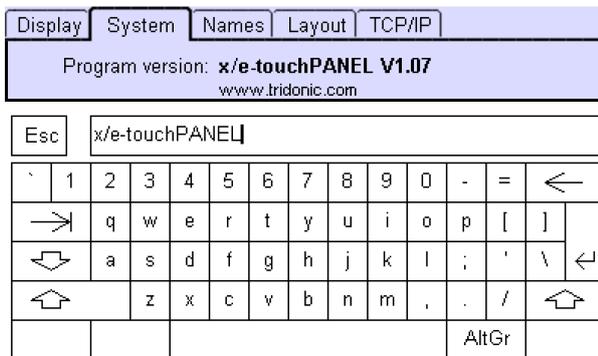

5. Enter the new name and confirm with the Enter key.
6. Click on the Esc key to cancel the process.

### 4.2.10. Rename Groups, Scenes, Sequences, Schedules.

It is possible to rename groups, scenes, sequences and schedules directly on your Computer.

Find more information in Interfaces section.

[Ethernet Rename Groups, Scenes, Sequences, Schedules, p. 108](#)

[USB Rename Groups, Scenes, Sequences, Schedules, p. 95](#)

# Emergency Application

## 5.1. Overview

### 5.1.1. Design and function

Up to 120 DALI emergency units can be controlled and monitored with the x/e-touchPANEL in Emergency Application. In addition, the emergency lighting tests prescribed in the relevant standards can be performed automatically. The test results are recorded in a log file for verification.

The x/e-touchPANEL with a colour touchscreen provides the following functions for operating the emergency units:

- \_ Addressing and grouping
- \_ Identification
- \_ Manual tests
- \_ Time-controlled function and duration tests
- \_ User-friendly software

A frame light is integrated in the x/e-touchPANEL. It supports the status line of the system.

### 5.1.2. Main pages

The menu of the x/e-touchPANEL consists of three main pages:

- \_ System status
- \_ Test protocol
- \_ Main menu

These pages are opened by clicking on the following symbols:

Symbol	Page
	System status
	Test protocol
	Main menu

## Emergency Application

### 5.1.3. System status

OK is displayed on the System status page if there are no errors in the system. The number of installed emergency units is also indicated.



Error is displayed on the System status page if there is an error in the system. The number of errors is also indicated.



### 5.1.4. Test protocol

The function and duration tests performed including their dates and results are recorded for every emergency unit on the Test protocol page.

The screenshot shows a table titled 'Test Protocol' with a red status indicator in the top right corner. The table has four columns: 'Addr', 'Name', 'Test', and 'Status'. The rows represent different emergency units, with the status of each test recorded. A vertical scrollbar is visible on the right side of the table.

Addr	Name	Test	Status
A6 (G1)	?	FT, 11.07.2012	OK
A5 (G6)	?	FT, 11.07.2012	OK
A4 (G5)	?	FT, 11.07.2012	RAT
A3 (G4)	?	FT, 11.07.2012	OK
A2 (G3)	?	FT, 11.07.2012	OK
A1 (G2)	?	FT, 11.07.2012	OK
A0 (G1)	?	FT, 11.07.2012	OK
A6 (G1)	?	FT, 11.07.2012	OK

A navigation bar at the bottom contains three icons: an information icon, a clipboard icon, and a gear icon.

## Emergency Application

### **i** NOTICE

"TestBook" entries are written to the buffer memory. If the memory is full, the oldest "Test Book" will be deleted to make room for new entries.

The following calculation shows how many entries can be saved before this is the case.


Parameter	Wert
Total size of buffer memory:	655,360 bytes
Data needed for one "TestBook" entry:	24 bytes
Max. number of "TestBook" entries:	$655,360 \text{ bytes} / 24 \text{ bytes} = 27,306 \text{ entries}$
Capacity of the buffer memory for one test per week and device:	$655,360 \text{ bytes} / (24 \text{ bytes} * 128 \text{ devices}) = 213 \text{ weeks } 4 \text{ years}$

If durations tests and negative communication tests are also performed, the time decreases. But even then, the size of the buffer memory is sufficient for more than 2 years.

If the feature "cyclic communication test" is used the test-book may be overwritten!

### 5.1.5. Main menu

The basic system settings can be adapted, the emergency units assigned and the tests configured in the Main menu.

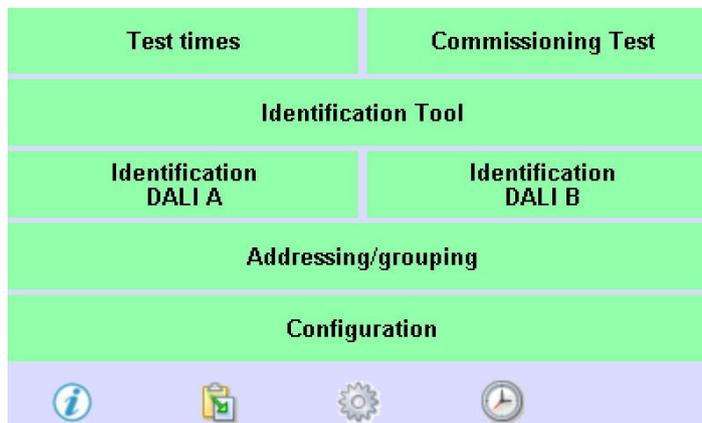

The following functions can be accessed using the buttons on the "Main menu":

Button	Function
Test times	Used to specify a time schedule for the function and duration test
Commissioning test	Used to start the function and duration test manually
Identification tool	Used to convert the identification flashing into the emergency unit address
Identification DALI A	Used to start and stop the identification flashing of the status LEDs of the DALI line A emergency units

## Emergency Application


Identifikation DALI B	Used to start and stop the identification flashing of the status LEDs of the DALI line B emergency units
Addressing/grouping	Used to assign an address to the emergency units and divide them into groups
Configuration	Changes the basic settings of the specific emergency lighting functions

## 5.2. Settings for Emergency Application

### 5.2.1. Adjusting the frame light

The x/e-touchPANEL has an additional frame light that supports the system's status line.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Click on the "Framelight" button.  
-> The dialog box "Frame Light:" is displayed.

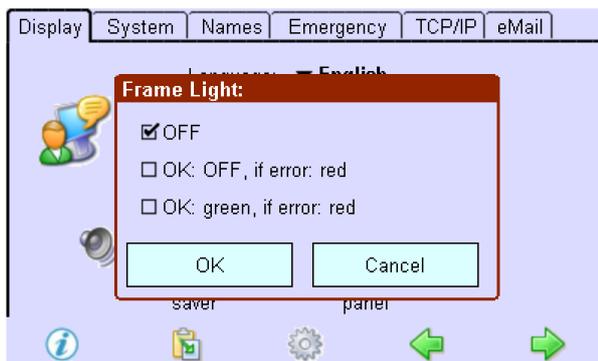

4. Activate the desired option field and confirm with OK.  
The following options are available:


Option field	Function
Off	Frame light is switched off
OK: Off, in the case of an error: red	Frame light lights up red if the Error status is indicated.
OK: green, in the case of an error: red	Frame light lights up green if the status is OK and lights up red if the status is Error.

### Entering the unit/group name


The unit and group name is indicated in the test protocol.

## Emergency Application

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "Names" tab  
-> The "Names" tab is displayed.

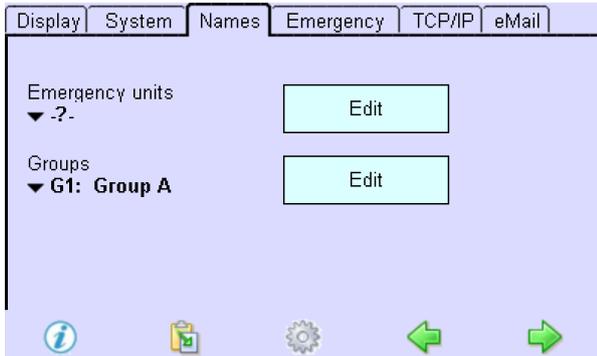

4. Click on the "Emergency units" dropdown menu and select the emergency unit.
5. Click on the Edit button to enter a name for the emergency unit.  
-> A keyboard is displayed.

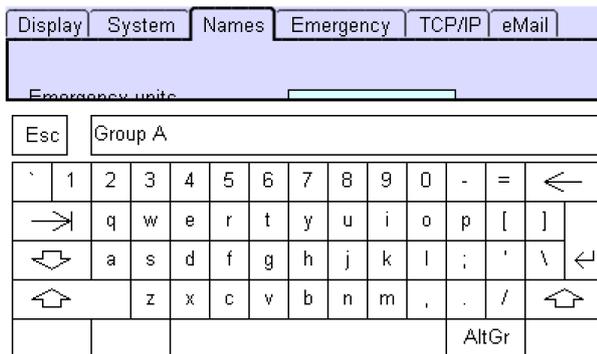

6. Enter a unit name and confirm with the Enter key.
7. Repeat steps 2 to 4 for other units or groups.

## Emergency Application

### 5.3. DALI communication test

The consistency of the DALI connection can be tested if necessary. The command Recall max and Recall min are transmitted alternately seconds apart.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.  
-> The dialog box "Addressing method:" is displayed.
3. Select the "DALI-A" or "DALI-B" line in the DALI Communication test menu item.
4. Click on the "Next >" button.  
-> The test is performed.
5. Repeat step 3 for the other DALI line if necessary.

## Emergency Application

### 5.4. Addressing and grouping emergency units

Every emergency unit must be assigned an individual address in order for the x/e-touchPANEL to be able to communicate with the emergency units. Three addressing methods are differentiated:

- \_ System extension: If new emergency units have been added to an existing system, an address is assigned to these units. The addresses of the existing DALI devices remain unchanged.
- \_ Reinitialization: A new address is assigned to all DALI devices in the system.
- \_ No device search, only grouping: If emergency units are to be regrouped in an existing system. The existing DALI devices can be regrouped. The addresses of the existing DALI devices remain unchanged.

During the addressing process, the emergency units are automatically divided into six groups.

A time and day of the week can be set for every group at which the tests are to be performed. This prevents the emergency units from being tested simultaneously.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.  
-> The dialog box "Addressing method:" is displayed.

#### NOTICE

When the "Addressing/grouping" button is clicked for the first time a page will open with information about registering the x/e-touchPANEL software. By default the check box "Remind me again in 24 hours" is activated.




- \_ Leave the checkbox activated to be reminded again 24 hours later  
- or -
- \_ Deactivate the checkbox by removing the tick to not be reminded again.

After a reset to factory settings the page will appear again when clicking the "Addressing/grouping" button for the first time.

3. Select the addressing method "System extension" or "Reinitialization".
4. Click on the "Next >" button.  
-> The number of connected emergency units is displayed.
5. When the message "Search completed" is displayed, click on the Complete button.  
-> The Grouping page is displayed.  
-> Each emergency unit is displayed as part of a group.

## Emergency Application

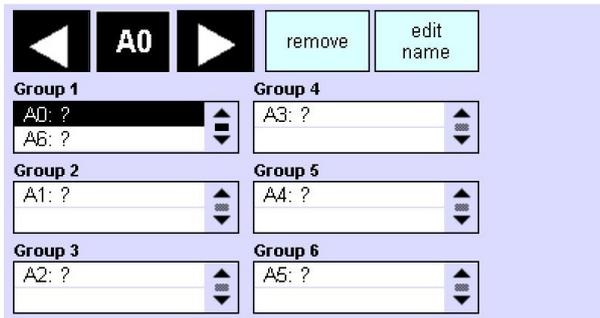

- Click on the Save symbol in order to save the grouping in the emergency units.


### 5.4.1. Changing the grouping

Based on an algorithm, the emergency units are assigned to six groups. Normally, the grouping does not have to be changed. In special cases, such as e.g. the simultaneous testing of all emergency units of a room, the grouping can be changed:

#### **i** NOTICE

The grouping of emergency units can only be changed after having performed the addressing method. Select the addressing method Grouping only, no search for devices so that existing addresses are maintained.


- Click on the Main menu button.
- Click on the Addressing/grouping button.
- Select the addressing method "Grouping only, no search for devices"

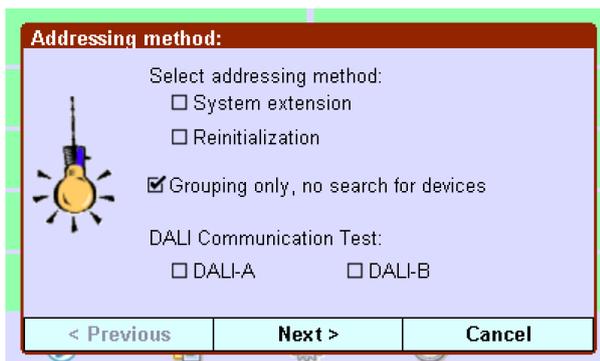


-> The addresses of existing DALI devices remain unchanged.

- Click on the "Next >" button.
- When the message "Search completed" is displayed, click on the Complete button.  
-> The Grouping page is displayed. Each emergency unit is displayed as part of a group.

## Emergency Application

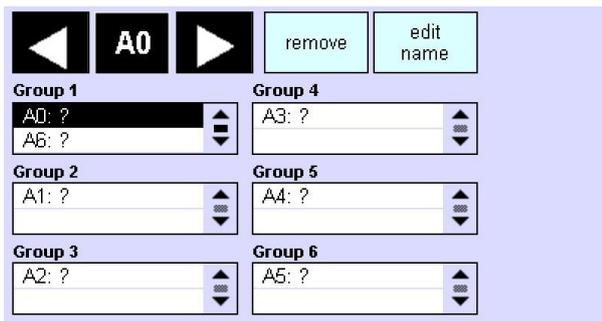

6. Mark the emergency unit for which you want to change the grouping in the Test group field.  
- or -  
Select the address of the emergency unit using the arrow keys.
7. Click on the remove button.
8. Move the address of the emergency unit to the desired group using Drag & Drop (Test group field).  
-> The emergency unit is displayed in the group.
9. Repeat steps 1 to 3 for other emergency units if necessary.  
-> After the automatic addressing, the addresses (DALI A0 to A63 and DALI B64 to B127) and specific operating devices, if necessary, are displayed (e.g. HID).  
-> The following operating elements are available for grouping:

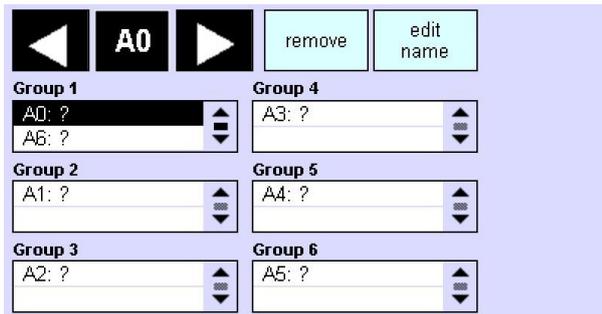

Element	Meaning / Function
	Use the arrow keys to select the operating device that is to be assigned to a group.
	Use the button to remove the selected device from the group.
	Use the button to edit the name of the selected device from the group.

## Emergency Application

	<p>The "Group" box shows which operating devices belong to a specific group. Devices can be selected and removed from the group</p>
	<p>The Save button opens up the dialog box "Save as group". Select a group in which you save the current settings.</p>

### **i** NOTICE

If an operating device is assigned to several groups, the value of the highest group number is saved.

For a more detailed explanation:

- \_ DALI has max. 16 groups
- \_ Devices can be assigned to multiple groups
- \_ Several groups can be assigned to a scene

If now a scene is called and that scene is assigned to several groups. And several of these groups include the same device, there may be a conflict, because it is not clear which of the values the device saves. In this case, the rule above applies.

#### **Example 1:**

- \_ Device 1 is in G1 and G2
- \_ Both groups are assigned to scene x:
  - \_ G1: 100% dimming level
  - \_ G2: 30% dimming level

=> Device 1 goes to 30% dimming level (value of group 2)

#### **Example 2:**

- \_ Device 2 is in G1 and G2
- \_ Group G1 is assigned to scene y:
  - \_ G1: 100% dimming level

=> Device 2 goes to 100% dimming level (value of group 1)

## Emergency Application

### 5.5. Programming the prolong time


If necessary, emergency lighting operation can be prolonged by a maximum of one hour once the power has been restored, e.g. to bridge the restarting time of high-pressure lamps in the case of short mains voltage interruptions.

The basic setting of the emergency units is 0 minutes.

#### **i** NOTICE

The prolong time can only be maintained if there is sufficient battery capacity.  
The Configuration menu is open.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed.
2. Click on the "Configuration" button.  
-> The "Configuration" page is displayed.
3. Click on the "Emergency" tab.
4. -> The "Emergency" tab is displayed
5. Click on the Prolong time dropdown menu and select the desired time.

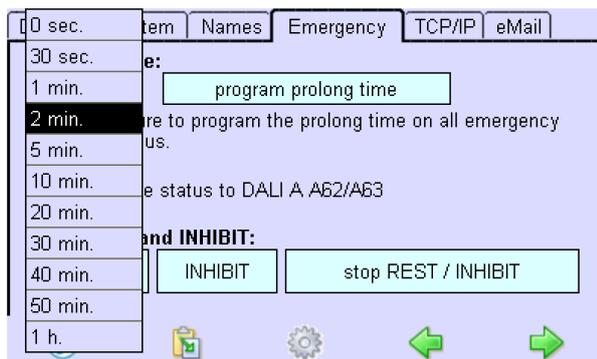

6. Click on the Program prolong time button.

## Emergency Application

### 5.6. Configuring the error signalling

Two DALI addresses of DALI line A can be defined for fault signalling.

In this way, the error status can be transmitted to a higher-level system via relay modules DALI RM or DALI 3-RM-C or indicated by signal lamps.

#### **i** NOTICE

Error signals can only be received on DALI line A.

DALI is based on random addressing. This means that the interface devices can be assigned any of 64 possible addresses. DALI RM, e.g., can be assigned address A4. As before, 60 emergency units can be connected. Addresses higher than A60 are also possible for emergency units.

#### 5.6.1. Specifying DALI addresses for error signalling

#### **i** NOTICE

Only addresses that are not assigned an emergency unit can be used for error signalling.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.
3. Select addressing method "System extension", "Reinitialization" or "Grouping only, no search for devices".  
-> With "System extension" the addresses of existing DALI devices remain unchanged.  
-> With "Reinitialization" a new address is assigned to all DALI devices in the system.
4. Click on the "Next >" button
5. When the message "Search completed" is displayed, click on the Complete button.  
-> The Grouping page is displayed. Each emergency unit is displayed as part of a group.



6. Press the green arrow key at the bottom right.  
-> The dialog box to select the two addresses for error signalling is displayed. Only addresses are displayed that are not assigned an emergency unit.

## Emergency Application




7. Use the arrow keys to select both addresses for the "Status report: OK" and "Status report: Error".
8. Click on the green arrow key at the bottom right and select the Save symbol.  
-> The two addresses for error signalling are stored.

## Emergency Application

### 5.6.2. Activating the error signalling

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "Emergency" tab
4. -> The "Emergency" tab is displayed

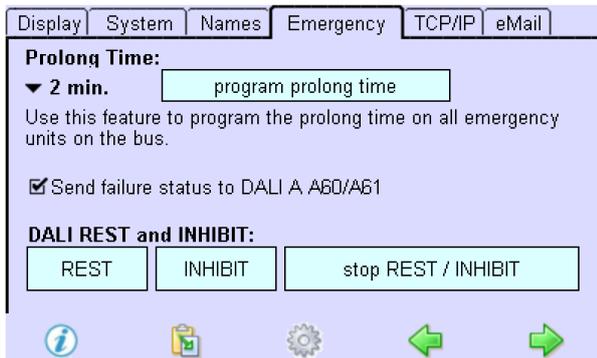

5. Activate the check box "Send failure status to DALI A...".  
-> Error signalling is activated.  
-> The following messages are displayed at the error signalling addresses:

Status report	Meaning
OK	No error is present on both DALI lines.
Error	An error is present (on one of the two DALI lines).

## Emergency Application

### 5.7. Identifying emergency units


In order to indicate the defective emergency unit if a malfunction has occurred, the emergency units can be identified individually.

For identification, the status LEDs of the emergency units flash green and red alternately. After having flashed six times, there is always a pause. These six flashes represent the address of the emergency unit as a binary code that can be converted into a decimal number with the identification tool in the x/ e-touchPANEL. The address, group name and device name (see "Entering the unit/group name, p. 20") are displayed in the test protocol.

A software that can be installed on JAVA-capable mobile phones is another option. ([www.tridonic.com](http://www.tridonic.com) > Service > Software: "EMpro Ident. TOOL V1.0"). The software also converts the binary LED identification signal into a DALI address.

Using the integrated identification tool on the x/e-touchPANEL you can determine the address of an emergency unit as described below:

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Identification DALI A" or "Identifikation DALI B" button.  
-> The LEDs of the emergency units flash green and red.
3. Click on the "Identification-Tool" button.  
-> The dialog box "Identification tool" is displayed.

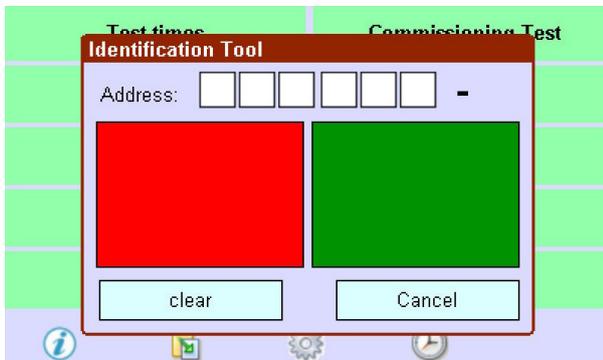

4. Wait for a flashing pause of the LED (approx. 3 seconds).
5. According to the colour of the status LED, click on the right or green field in the identification tool after every flashing pause.  
-> The binary code is indicated and converted into the address of the emergency unit after the sixth flashing.
6. Write down the address and the name of the emergency unit in the installation documents.
7. Click on the Clear button.
8. Repeat steps 4 to 7 for other emergency units.
9. After all emergency units have been identified, click on the Cancel button.
10. Click on the Identification DALI A or DALI B button to switch off the flashing of the status LEDs.

## Emergency Application

### 5.8. Manually testing emergency units

After all emergency units have been installed, addressed and identified, the function and duration time of the units must be tested.


During the test, the emergency units to be tested are switched on. A status line in the x/e-touchPANEL indicates the type of test (FT ›function test‹, DT ›duration test‹, CT ›communication test‹) and the respective groups. The status line is located at the bottom right of the touchpanel while the test is running.

#### **i** NOTICE


Depending on the emergency unit, the duration test can take up to three hours.  
The batteries must be charged for a minimum of 24 hours before the duration test can be started.

The batteries have been charged for at least 24 hours.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Commissioning Test" button.  
-> The dialog box "Start test" is displayed.

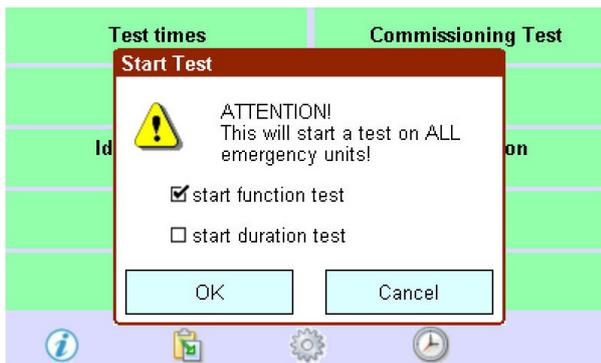

3. Select the check box "start function test" or "start duration test" and confirm with OK.  
-> The selected test is performed and displayed in the status line.



4. After the test has been completed, click on the Test protocol symbol:  
-> The Test protocol window is displayed.

Addr	Name	Test	Status
A6 (G1)	?	FT, 11.07.2012	OK
A5 (G6)	?	FT, 11.07.2012	OK
A4 (G5)	?	FT, 11.07.2012	BAT
A3 (G4)	?	FT, 11.07.2012	OK
A2 (G3)	?	FT, 11.07.2012	OK
A1 (G2)	?	FT, 11.07.2012	OK
A0 (G1)	?	FT, 11.07.2012	OK
A4 (G5)	?	FT, 11.07.2012	OK

## Emergency Application

5. To abort the test, click on the status line of the test.

-> The following information is displayed in the test protocol:

Column	Meaning	Possible cause	Corrective action
Adr	Address and group of emergency unit		
Name	Name of emergency unit		
Test	Type of test (FT = function test, DT =duration test, CT = communication test) and date of test		
Status	Result of test:		
	OK Test successful	-	
	 Lamp defective, Lamp Error	<ul style="list-style-type: none"> <li>_ Lamp error</li> <li>_ Lamp wrong</li> <li>_ Lamp wiring wrong</li> </ul>	
	 Battery fault, Battery Failure	<ul style="list-style-type: none"> <li>_ Battery capacity too low</li> <li>_ Battery defective</li> <li>_ Battery wiring wrong</li> </ul>	
	 Error in the emergency unit, Charger Failure	<ul style="list-style-type: none"> <li>_ Emergency unit defective</li> </ul>	
	 Communication error	<ul style="list-style-type: none"> <li>_ Emergency unit defective</li> <li>_ Emergency unit has been replaced but not addressed</li> <li>_ DALI wiring error</li> </ul>	
	 Test Failure, Case 1: Test could not be performed within 24 hours.	<ul style="list-style-type: none"> <li>_ <b>Duration test was interrupted</b></li> <li>_ <b>Battery was not fully charged because of power failure</b></li> </ul>	<ul style="list-style-type: none"> <li>_ Charge battery for at least 20 hours and start duration test manually</li> </ul>

## Emergency Application

<b>!T</b> Test Failure, Case 2: Function test was performed. But the previous duration test ended with an error (failed to reach full operating time) which hasn't been corrected.	_ Even if the function test is performed successfully, the x/e-touchPANEL shows the error message !T to signal that the error detected during the last duration test has not been corrected.	_ Replace battery and perform operation test manually.
---	--	--

6. Click on the Next error symbol to jump to the next error entry.



### **i** NOTICE

If a fault has been eliminated, this must be verified by performing a test on this emergency unit. If a battery was replaced, the test cannot be performed until 24 hours later because the battery needs to be fully charged for testing

7. To test a single emergency unit, click on the respective emergency unit in the Test column

### **i** NOTICE

If a function or duration test was interrupted by a mains failure, the x/e-touchPANEL remembers this. After the power supply has been restored, the x/e-touchPANEL automatically starts the test again.

## Emergency Application



### 5.9. Determining the starting time for automated testing

To automate a function test, duration test or communication test for an emergency unit the starting time must be determined. Individual times can be set separately for each group. This ensures that in the case of a power failure a sufficient number of lamps are in working order.

The default settings for the testing times are:

- \_ G1: Monday, 23:00 h
- \_ G2: Tuesday, 23:00 h
- \_ G3: Wednesday, 23:00 h
- \_ G4: Thursday, 23:00 h
- \_ G5: Friday, 23:00 h
- \_ G6: Saturday, 23:00 h

In addition to the times, the intervals for the function and duration tests must also be specified:

Test	Interval	Meaning
Function test	manual	The function test must be performed manually.
	weekly	The function test is performed every week.
	every 2nd week	The function test is performed in the first and third week of the month.
	monthly	The function test is performed in the first week of the month.
Duration test	manual	The duration test must be performed manually.
	monthly	The duration test is performed in the first week of the month.
	quarterly	The duration test is performed in the first week of following months. 
	every 6 months	The duration test is performed in the first week of following months. 
	yearly	The duration test is performed in the first week of months 1-12 (adjustable).
Communication test	daily	The communication test is performed daily, the time can be chosen freely
	cyclic	The communication test will be performed every 4 seconds.

## Emergency Application

### NOTICE

The first week of a month is defined to last from the 1st to the 7th day of the month. The third week of a month is defined to last from the 15th to the 21st day of the month. On days when a duration test is performed, no function test is performed for this group..

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Test times" button.  
-> The "Automatic tests" page is displayed.

**Automatic Tests**

Function test	Duration test	Comm.test
<input type="checkbox"/> manual	<input type="checkbox"/> manual	daily:
<input checked="" type="checkbox"/> weekly	<input type="checkbox"/> monthly	<input type="text" value="00:00"/>
<input type="checkbox"/> every 2nd week	<input checked="" type="checkbox"/> quarterly	
<input type="checkbox"/> monthly	<input type="checkbox"/> every 6 months	
	<input type="checkbox"/> yearly	

extended OK Cancel

3. Specify the intervals for the function and duration tests.
4. Click on the "extended" button.  
-> The dialog box "Extended settings" is displayed.

**Automatic Tests**

**extended settings**


Func	G1	G2	G3	G4	G5	G6	test
<input type="checkbox"/> ma							
<input checked="" type="checkbox"/> we	▼ Mon	▼ Tue	▼ Wed	▼ Thu	▼ Fri	▼ Sat	
<input type="checkbox"/> ew	23:00	23:00	23:00	23:00	23:00	23:00	
<input type="checkbox"/> mo							

**Duration test:**  
Month: ▼ 3, 6, 9, 12


OK Cancel

5. For each group, set the day of the week and the time of day. Click on the respective dropdown menu and select the day of the week or the time of day, and set the desired time using the arrows.


## Emergency Application

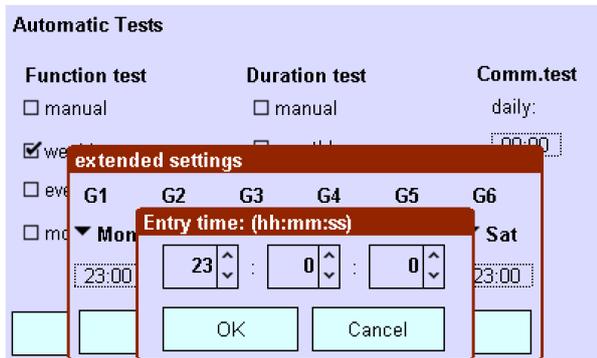

6. For the "communication test" click on the respective time.  
 -> The dialog box "Entry time" is displayed

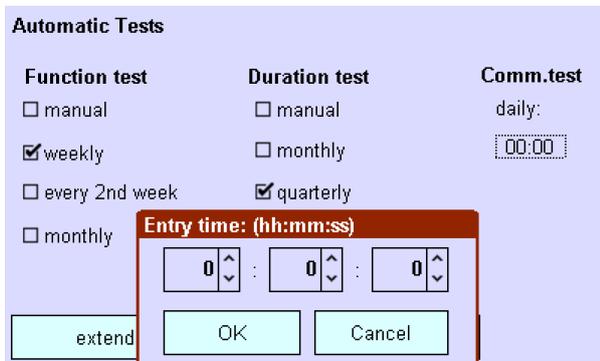

7. Set time
8. Confirm with click on "OK"  
 -> Starting time for "communication test" is set.
9. If the feature cyclic communication test is used the test will be repeated every 4 seconds.

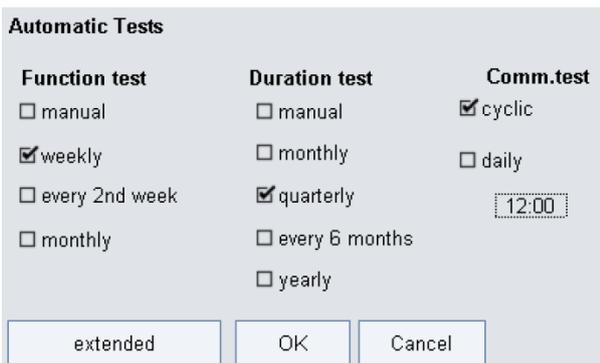

## Emergency Application

### 5.10. Set up eMail function

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
Click on the "eMail" tab
3. -> The "eMail" tab is displayed

Set up as follows:

4. "send email": activate one of the two options "if test OK" or "if test failed" (if "if test failed" was activated an additional option "for communication test" is available).
5. "to address": Enter the address to which the email should be sent
6. "from address": Enter the address you want to set as sender
7. "SMTP server": Enter appropriate server name. (Contact IT department if you don't know!)

#### **i** NOTICE

The x/e-touchPANEL sends over port 25.  
Make absolutely sure that the port is not blocked by a firewall!

8. "login": Enter the login name for the sender e-mail.
9. "password": Enter the password for the e-mail sender.

## Emergency Application

### 5.11. Deactivating emergency units

If the main power supply is switched off and you do not want the emergency units to switch on (e.g. in the case of a plant holiday), the emergency units can be deactivated in two ways:

- \_ Manually switching off the emergency units
- \_ Preventing the emergency units from switching on

**WARNING!**


**Bridging a safety device**  
Deactivated emergency units do not switch on in an emergency.

- \_ Ensure that there is no emergency.
- \_ Ensure that emergency operation is not necessary.

#### 5.11.1. Manually switching off the emergency units

The main power supply is switched off and there is no emergency. The power supply of the x/e-touchPANEL is switched on.

1. Ensure that emergency operation is not necessary.
2. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
3. Click on the "Configuration" button  
-> The "Configuration" page is displayed
4. Click on the "Emergency" tab  
-> The "Emergency" tab is displayed

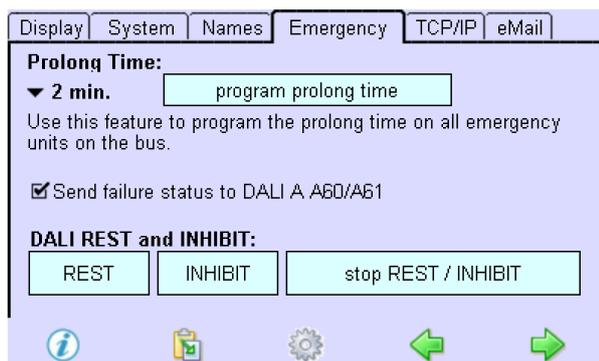

5. Click on the Rest button.  
-> The emergency units are switched off.  
-> When the main power supply is switched on again, the emergency units are reactivated.
6. To activate the emergency units before switching on the main power supply, click on the "stop REST / INHIBIT" button.

## Emergency Application

### NOTICE

Not all emergency units support the "stop REST / INHIBIT" function.

### 5.11.2. Preventing the emergency units from switching on

The main power supply is switched on.

1. Ensure that emergency operation is not necessary.
2. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
3. Click on the "Configuration" button  
-> The "Configuration" page is displayed
4. Click on the "Emergency" tab  
-> The "Emergency" tab is displayed
5. Click on the "Inhibit" button.  
-> The LEDs of the emergency units emit a green double flash.
6. Switch off the main power supply within 15 minutes.  
-> The emergency units do not switch on.  
-> When the main power supply is switched on again, the emergency units are reactivated.
7. In order to reactivate the emergency units without switching the main power supply on and off again, click on the "stop REST / INHIBIT" button.

### NOTICE

Not all emergency units support the "stop REST / INHIBIT" function.

# Basic, Colour, Plug Application

## 6.1. Overview

### 6.1.1. Design and functions

In the Basic, Colour and Plug Application the x/e-touchPANEL is an operating device and controller for DALI lighting systems. The xetouch software that is controlled using a colour touchscreen is integrated into the ›x/e-touchPANEL‹. It is possible to use it in combination with ›comfortDIM series‹ controllers.

The ›xetouch‹ software provides the following functions:

- \_ Applications
  - \_ Basic for white light applications
  - \_ Colour for RGBW applications
  - \_ Plug for simple RGBW applications with preconfigured operating devices where the addressing is already set using coded connectors
- \_ Configuration of
  - \_ 16 scenes
  - \_ 99 light sources
  - \_ 7 time-controlled schedules
  - \_ 1 calendar-controlled schedule list
  - \_ DT 8 (Tunable White)
- \_ Real-time clock/calendar
- \_ Configuration of the buttons for manual call-up
- \_ Design of the buttons for manual call-up
- \_ Manual switching and dimming
- \_ Frame light and adjustable display light
- \_ Communication via interfaces:
  - \_ USB
  - \_ Ethernet (TCP/IP)

Property	x/e-touchPANEL
Number of DALI lines	2
Connection	Maximum 128 DALI operating devices
Bus supply	External
Interfaces	USB, Ethernet
Frame light	yes

## Basic, Colour, Plug Application

Display light	Always ON or automatically dimmed 2 min. after last activation.
---------------	---

## Basic, Colour, Plug Application

### 6.1.2. »xetouch« software

The following explanations will help you understand the »xetouch« software.

Designation	Meaning
Operating device	DALI operating device
Group (G)	The »xetouch« software communicates with the operating devices (max. 64 per DALI line) via groups (max. 16). A group can be switched and dimmed individually. Groups can also include EM, HID, LV, INC, CONF, LED or Somfy operating devices.
Zone (Z)	Zones are only used in the Colour Application. One zone consists of four predefined groups representing the colours red, green, blue and white.
Scene (S)	A scene is used to save a lighting situation defined by the setting of one or several groups.
Sequence (SQ)	Several scenes are saved in a time-specific order in a sequence.
Schedule (SDL)	One or several sequences and/or scenes are saved in a time-specific order in a schedule. A schedule starts automatically every 24 hours at a preset time of the day.
Schedule list (SDLL)	Each schedule is assigned to one weekday. In this way, a schedule list is created for the calendar-controlled, uninterruptible automation of lighting situations.
Scheduler	When Scheduler is activated, it appears in the Home menu and enables a sequence, schedule list and schedule to be controlled manually (Start, Pause, Stop and Off).

### Basic Application

Typical application examples for the Basic Application are rooms where mostly white light is used, e.g. public rooms, production halls, restaurants and hotels.

You can define a maximum of

- \_ 16 groups with a total of 128 devices
- \_ 16 scenes
- \_ 99 sequences
- \_ 7 schedules
- \_ 1 schedule list

### Colour Application

All colours of the RGB colour space are the result of the addition of the basic colours red, green and blue (RGB). For a better representation of white light an additional white light source is used (RGBW colour mixing).

The colour control of a lighting system is performed in the Colour Application. The Colour Application is different from the standard Basic Application with respect to the grouping of the operating devices.

## Basic, Colour, Plug Application

In the »xetouch« software, each RGB-/RGBW operating device is assigned to the colour scale (red, green, blue, white) of a zone. Four zones with 4 colour scales are available. The colour scale of a zone corresponds to a group. In the Home menu, the white light can be switched and dimmed via groups 1 to 4.

The table shows the assignment of the 16 groups to the four colours of the individual zones. Zone assignment is automatically controlled by the software.

	W	R	G	B
Z1	1	5	6	7
Z2	2	8	9	10
Z3	3	11	12	13
Z4	4	14	15	16

Typical application examples for the Colour Application are rooms where mainly RGBW operating devices are used to implement freely design colour changes and colour effects, e.g. in shop windows, bars and exhibition spaces.

You can define a maximum of

- \_ 4 zones with the 4 colours red, green, blue and white with a total of 128 devices
- \_ 16 scenes for white light
- \_ 8 colour scenes
- \_ 99 sequences
- \_ 7 schedules
- \_ 1 schedule list

### Plug Application

With the Plug Application only one zone is used with the groups 1-4. The groups represent the colours red, green, blue and white. The assignment to a group is done via a connector on the operating device. The classification into scenes is not possible.

## Basic, Colour, Plug Application

### 6.1.3. Navigation

When you navigate through the »xetouch« software you are guided through menus that are called up by pressing symbols and buttons. Certain functions, such as grouping, can be operated using Drag & Drop, i.e. a symbol can be touched and dragged to the intended position on the touchscreen.

The symbols have the following meanings:

Button	Function
	Opens the Home menu.
	Opens the Main menu.
	Opens the dialog box Time & Date.
	Displayed when a function is active (e.g. called up sequence). Opens the page where the function is started/stopped.
	Opens the following or previous page in a menu.


### Home

In the Home menu, lighting situations can be called up manually (see also "[Operation in the Home menu](#), p. 75"). The number and selection of lighting situations are configured depending on the application. The buttons of the lighting situations can be designed as desired, e.g. with pictograms or specific names (see "[Configuring buttons in the Home menu](#), p. 78").

The following actions are possible in the Home menu:

- \_ Switching a scene on and off
- \_ Dimming group/s or all operating devices up and down
- \_ Switching a group on and off
- \_ Dimming a group up and down
- \_ Starting, interrupting and ending a sequence, schedule or schedule list
- \_ Deactivating the touchscreen for cleaning.


## Basic, Colour, Plug Application

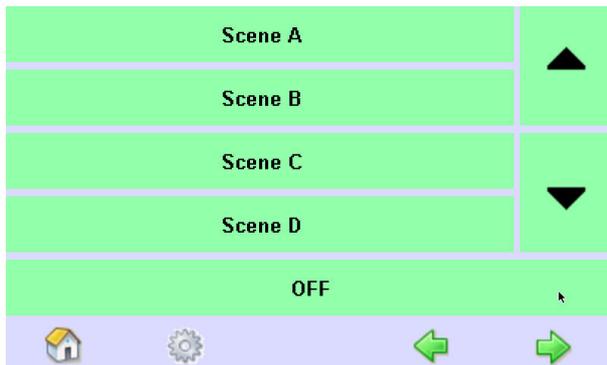

1. Click on the "Home" button.
2. Click on the arrow keys as often is necessary until the desired lighting situation is displayed (e.g. scene).
3. Click on the button to call up the lighting situation (e.g. scene).
4. Click on the arrow keys to dim the operating devices up or down.
5. Click on the OFF button to switch off the lighting situation.

### Main menu

In the Main menu, basic software settings are configured, lighting situations are defined and time sequences are specified. The Main menu is different in the Basic and Colour Applications.

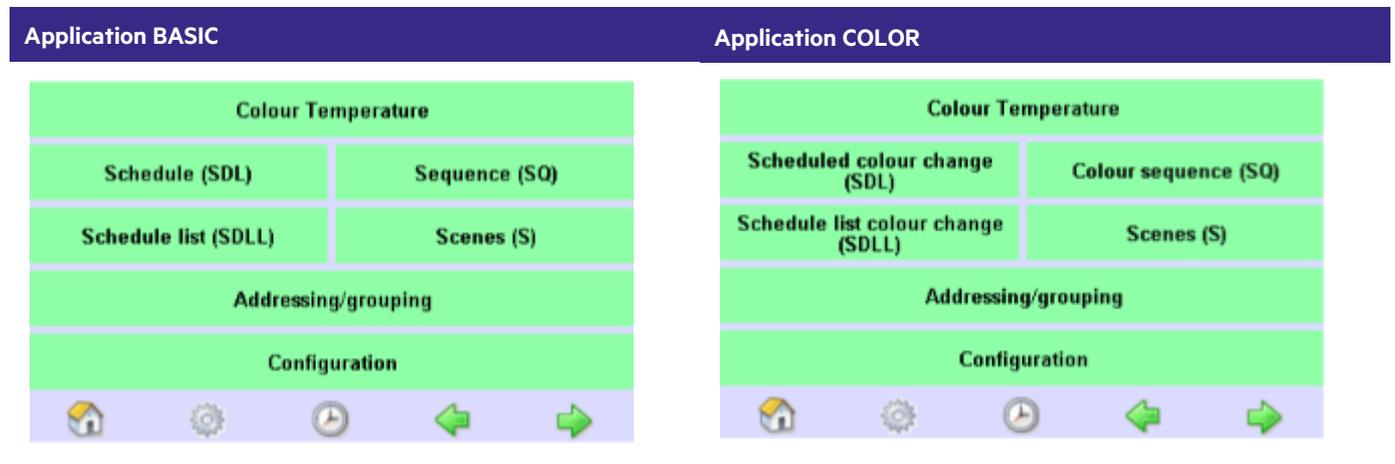

Button	Function
Colour Temperature	Opens the page where you can configure the Colour Temperature
Schedule list (SDLL)	Opens the page where you can assign schedules to certain weekdays. Schedule (SDL)Opens the page where you can define schedules.
Sequence (SQ)	Opens the page where you can assign sequences to a timeline and determine fade times.
Scenes (S)	Opens the page where you can assign the corresponding groups to a scene.

## Basic, Colour, Plug Application

Addressing/grouping	Opens the page where you can select the addressing method, address the devices and split them into groups or zones.
Configuration	Opens the page where you can configure the software and communicate via interfaces.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click the button for the desired submenu.

## Basic, Colour, Plug Application

### 6.2. Settings for DALI Applications

The following table provides an overview of the basic settings that can be defined in the tabs in the Configuration menu.

Tab	Entry	Function
Names	Sequences, edit	Name sequences 1 to 99 specific to the application.
	Scenes, edit	Name scene 1 to 16 specific to the application.
	Group, edit	Name group 1 to 16 specific to the application.
	Schedule, edit	Name schedule 1 to 7 specific to the application.
	User defined buttons	Use application-specific graphics for buttons in the Home menu.
Layout	S1...S4, S5...S8, S9...S12, S13...S16	Select buttons for the Home menu (4 scenes on each page).
	Dim	Activate the dimming function for the buttons that are activated in column 1.
	S1...S8, S9...S16 (Colour Application: 2 zones, 4 zones, colour scenes)	Select buttons for the Home menu (8 scenes on a page; 2 zones, 4 zones or 8 colour scenes on each page in the Colour Application).
	Scheduler Activate the Scheduler.	The Scheduler enables a sequence, schedule list and schedule to be controlled manually (Start, Pause, Stop and Off).
	G1...G4, G5...G8, G9...G12, G13...G16 (Colour Application: G1...G4)	Select buttons for the Home menu (4 groups on each page). In the Colour Application it is only possible to have the 4 white groups.
	Clean Select the Clean, OFF and ON buttons.	Clean deactivates the touchscreen for 20 seconds for cleaning. The OFF and ON buttons switch configured lighting situations.

#### 6.2.1. Setting the frame light and display light

The frame light is controlled in two intervals. Therefore, you can assign one colour for each interval to the frame light or switch it off for one interval (e.g. night service). Select the colour in the dialog box Frame light.


If you do not activate the screen saver, Tridonic recommends using the display light Dimmed automatically for the x/e-touchPANEL since this setting will prevent an image persistence.

Time and date are set.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Click on the Frame light button to change the frame light or display light.

## Basic, Colour, Plug Application

-> The dialog box "Framelight & display light" is displayed.

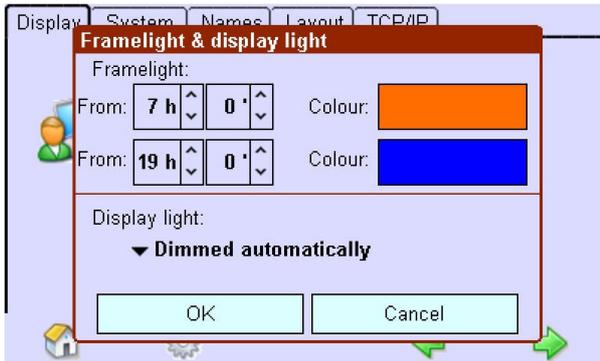

4. To set the two starting times for the frame light, use the arrow keys to set the times.
5. To set the frame light colour, click on the colour field and then select the desired colour or enter the colour using the RGB values and confirm with OK.  
- or -  
To switch off the frame light, click on 'Black' or enter the RGB values 0/0/0 and confirm with OK.  
-> The frame light is displayed in the selected colour or goes out.
6. Click on the arrow key to set the display light.  
-> The selection box is displayed.
7. Activate the Automatically dimmed entry to dim the display light 2 minutes after last activation.  
-or -  
Activate the Always on entry to leave the display light constant.


### 6.2.2. Assigning names

You can assign application-specific names to Scenes, Sequences, Groups and Schedules to facilitate configurations and operating steps at a later stage.


Names are assigned in the same way for scenes, sequences, groups and schedules.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "Names" tab  
-> The "Names" tab is displayed
4. Click on an arrow key below the entries Sequences, Scenes, Groups or Schedules  
-> The selection box is displayed.

## Basic, Colour, Plug Application

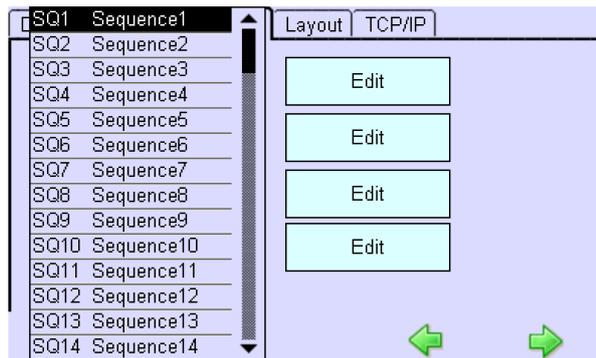

5. Select the lighting situation and click on the "Edit" button next to it.  
-> The dialog box Keyboard is displayed.

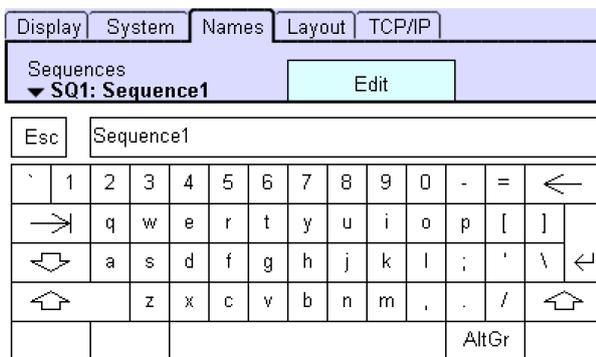

6. Enter the new name and confirm with the Enter key.
7. Click on the Esc key to cancel the process.

[Ethernet Rename Groups, Scenes, Sequences, Schedules, p. 108](#)

[USB Rename Groups, Scenes, Sequences, Schedules, p. 95](#)

### 6.2.3. Selecting a screen design for the Home menu

Different screen designs can be selected for the Home menu: The Display tab is open in the Configuration menu.


1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.
3. Click on an arrow key under the "Design" entry  
-> The selection box is displayed: A Classic, Classic Grey, Modern or a user defined design can be selected.

## Basic, Colour, Plug Application




4. Select the desired design.

If the Modern design as been selected, the main menus will be shown as Menu 1 or Menu 2, for example.

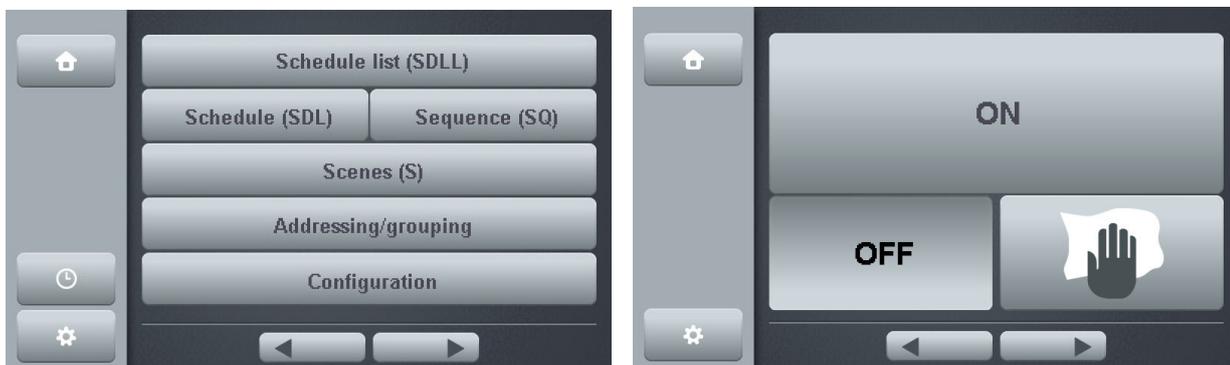

For the Designs Classic and Classic Grey the background colour can be changed.

### How to

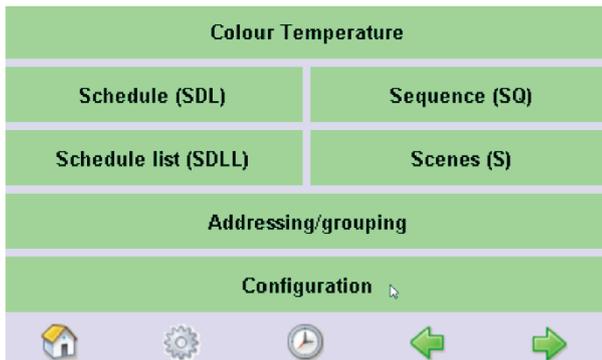


Go to main menu and select Configuration

## Basic, Colour, Plug Application



In the Display window you will see the new field Colour.

Select the field Colour.

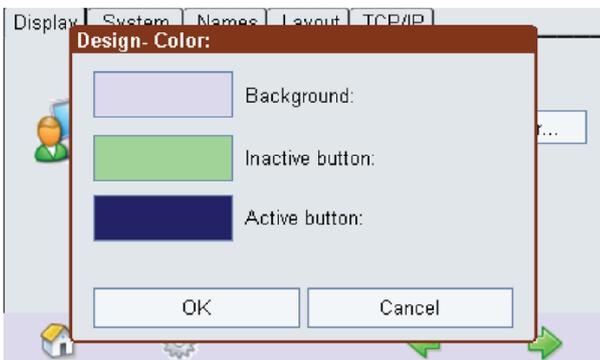

In the new Field you can change the Design colours.


For Background, inactive buttons and active buttons.




The colour can be changed in two ways.

By clicking in the colour field.

## Basic, Colour, Plug Application

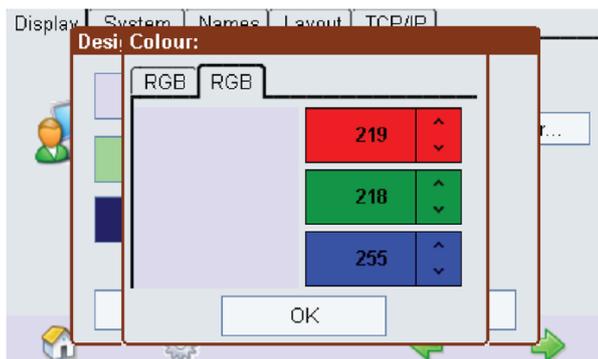

Or by typing in the RGB values.

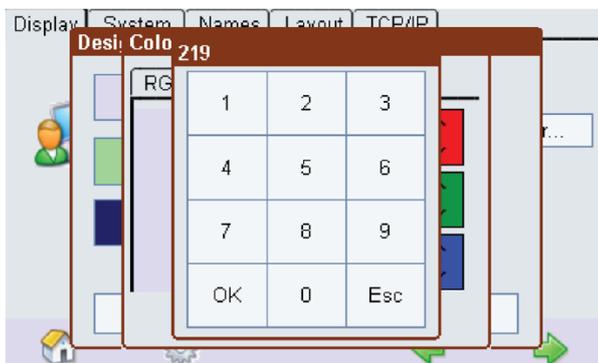

### **i** NOTICE

The following only shows illustrations for the Classic design.

## Basic Application

### 6.3. Basic Application

This chapter contains the following topics:

- \_ Addressing and grouping
- \_ Scenes
- \_ Sequences
- \_ Schedules (SDL)
- \_ Schedule list (SDLL)

#### **i** NOTICE

You can assign names for groups, scenes, sequences and schedules to facilitate programming and operating steps (see "[Assigning names](#), p. 49").

#### 6.3.1. Addressing and grouping

Each operating device in the system must be individually addressed and assigned to a group so that the x/e-touchPANEL can communicate with the operating devices. In Basic Application Addressing is performed automatically; grouping has to be done manually.


With the following operating devices, the address number is supplemented by the specific abbreviation. The identification of the components is only displayed if this is supported by the devices.

Device Type	Abbreviation	Type	Example (Tridonic)
DT 0		Fluorescent lamps	PCA
DT 1	EM	Self-contained emergency lighting	EM - PRO
DT 2	HID	Discharge lamps (excluding fluorescent lamps)	PCI Outdoor
DT 3	LV	Low voltage halogen lamps	TE o4a
DT 4	INC	Supply voltage controller for incandescent lamps	PCD 300 o4a
DT 5	CONF	conversion from digital signal into d.c. voltage	
DT 6	LED	LED modules (Converter)	LCAI
DT 7	SOMFY	Relais	Somfy
DT 8		Colour	Tunable Wite
DT 9		Sequenzler	

## Basic Application

DT 10	optical control	
-------	-----------------	--

The dialog box Addressing method offers three addressing options:

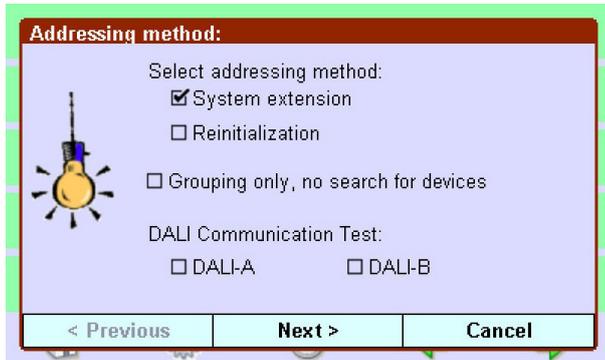


- \_ System extension:  
Only newly added operating devices are addressed. The existing addresses remain unchanged.
- \_ Reinitialization:  
All operating devices in the system are re-addressed. The existing addresses are overwritten.
- \_ No device search, only grouping:  
Only existing devices are displayed and can be regrouped.  
After the automatic addressing, the addresses (DALI A 1 to 64 and DALI B 65 to 128) and specific operating devices are displayed as required (e.g. HID).

The following operating elements are available for grouping:



Element	Meaning / Function
<b>Addressing of G1: Group A</b>	The group number (G1) is factory preset at the factory; the group name (Group 1) can be freely assigned.
	Use the arrow keys to select the operating device that is to be assigned to a group.

## Basic Application

	Use the button to remove the selected device from the group.
DALI numbering scheme: <input type="checkbox"/> A1..A64, G1..G16 <input checked="" type="checkbox"/> A0..A63, G0..G15	Use the check box to select if the numbering of the devices and groups is to start with 1 or 0.
	The Folder button opens up the dialog box Select group.
	The Save button opens up the dialog box Save as group. Select a group in which you save the current settings.

### NOTICE

If an operating device is assigned to several groups, the value of the highest group number is saved.

For a more detailed explanation:

- \_ DALI has max. 16 groups
- \_ Devices can be assigned to multiple groups
- \_ Several groups can be assigned to a scene

If now a scene is called and that scene is assigned to several groups. And several of these groups include the same device, there may be a conflict, because it is not clear which of the values the device saves. In this case, the rule above applies.

#### Example 1:

- \_ Device 1 is in G1 and G2
- \_ Both groups are assigned to scene x:
  - \_ G1: 100% dimming level
  - \_ G2: 30% dimming level

=> Device 1 goes to 30% dimming level (value of group 2)

#### Example 2:


- \_ Device 2 is in G1 and G2
- \_ Group G1 is assigned to scene y:
  - \_ G1: 100% dimming level

=> Device 2 goes to 100% dimming level (value of group 1)

## Somfy

If the Groups are displayed in the Home menu, the dimming function is replaced by the blind method if there is an integrated controller for the blinds (Somfy). This is indicated as follows:

## Basic Application

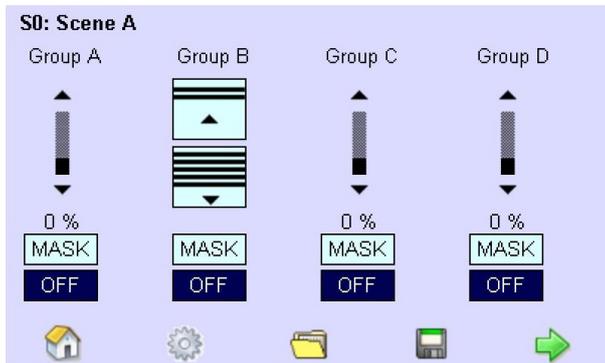


### Tunable White

When using DT8 DALI devices the dimming function is replaced by the Tunable White method.

Colour temperature from cooler to warmer and vice versa is changed in mirek steps.

This is indicated as follows:

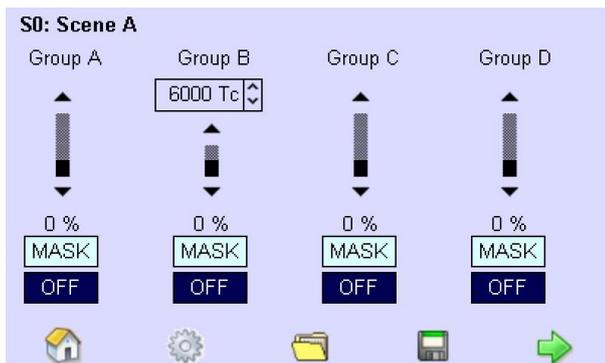

Tunable white system with DT8 can use different methods of operating and setting up light color and dimm level.

With x/e touch panel you are able to use color temperature.

Not supported Colour types are: xy-coordinate, primary N, RGBWAF

### DALI communication test

The consistency of the DALI connection can be tested if necessary. The command Recall max and Recall min are transmitted alternately seconds apart.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.  
The dialog box Addressing method is displayed.
3. Select the "DALI-A" or "DALI-B" line on the "Addressing method:" page.
4. Click on the "Next >" button.  
-> The test is performed.
5. Repeat step 3 for the other DALI line if necessary.

## Basic Application

### Addressing and grouping operating devices

For the x/e-touchPANEL, addresses A1-A64 are assigned for DALI line A and addresses B1-B64 are assigned for DALI line B.

#### **i** NOTICE

Use Drag & Drop to group the operating devices, i.e. touch the device address and drag the symbol over the touchscreen to the group field.  
The corresponding operating device reacts when the device address is touched.

#### **i** NOTICE

Tridonic recommends saving Somfy operating devices in separate groups, i.e. separately from other operating devices.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.  
-> The dialog box "Addressing method:" is displayed.

#### **i** NOTICE

When the Addressing grouping button is clicked for the first time a page will open with information about registering the x/e-touchPANEL software. By default the check box "Remind me again in 24 hours" is activated.




- \_ Leave the checkbox activated to be reminded again 24 hours later  
- or -
- \_ Deactivate the checkbox by removing the tick to not be reminded again.

After a reset to factory settings the page will appear again when clicking the "Addressing/grouping" button for the first time.

3. Activate the "System extension" or "Reinitialization" check box.
4. Click on the "Next >" button.  
-> The x-touch software looks for operating devices that are connected and displays the number of operating devices found.
5. When the message "Search completed" is displayed, click on the Complete button.

## Basic Application

- > Each device is addressed.
  - > The page Addressing of G ... is displayed.
6. Click on the Folder button to select the group in which the operating devices are to be saved.
    - > The dialog box "Select group" is displayed.
  7. Use the arrow keys to select the group and confirm with OK.
    - > The group is displayed.
  8. Use the arrow keys to select the address of the operating device.
  9. Move the operating device (1) into the group field using Drag & Drop.
    - > The device address is displayed in the group field of the currently selected group.

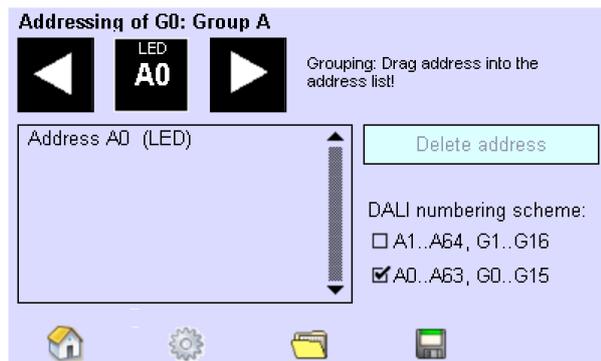


10. Use the arrow keys to select other addresses and drag them into the same group field.
11. Click on the Save button.
  - > The dialog box Save as group is displayed.
12. If necessary, change the group in which the operating devices are to be saved and confirm with OK.
  - > The group is saved.
13. Repeat steps 5-11 until each operating device is assigned a group.

### NOTICE

The grouping is only saved when you click on the Save button and confirm with OK in the dialog box.

### 6.3.2. Colour Temperature

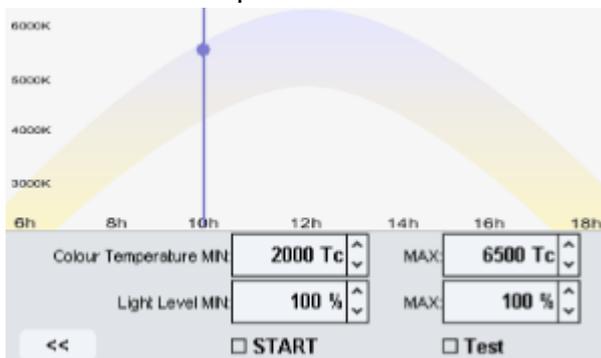

## Basic Application

Colour Temperature allows you to change the Colour Temperature over the day.

In this window you can set the min. and max. Colour Temperature.

Also the min. and max. Light Level can be set.

If you set the min. and max. Light Level to 101% then no Light Level will be send.

To test the function select the Test field.

To start the function select the Start field.




Select  to go back to main menu.

### Scene


One or several groups are saved in a scene. The groups are dimmed, masked or switched off in such a way that a demand-driven lighting situation is created. A maximum of 16 scenes, each with a maximum of 16 groups, can be saved in each scene.

The following operating elements are available to set a scene:

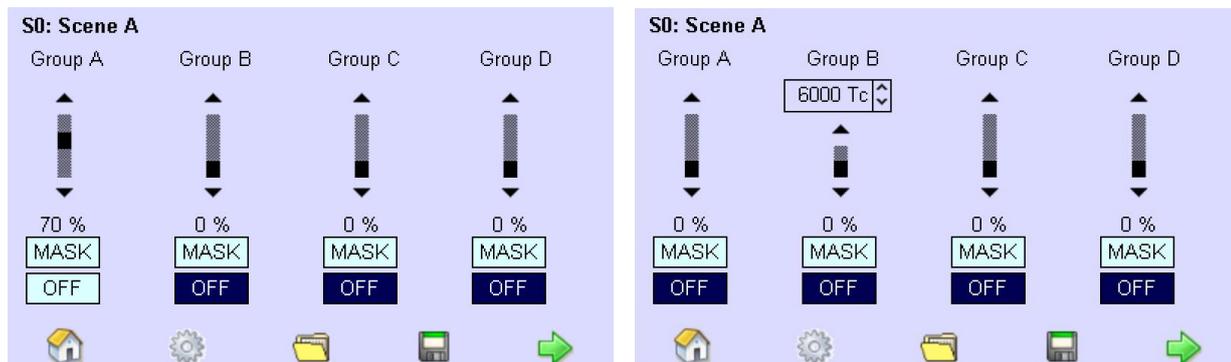

Element	Meaning / Function
<b>S1: Szene 1</b>	The scene number (S1) is preset at the factory; the scene name (Scene 1) can be assigned as desired.
	A scroll bar visualises the setting of the dimming value. Change the dimming value using the arrow keys or the black area on the scroll bar. The dimming value is displayed as a percentage (51) under the scroll bar.
	If a group is used for Somfy components, the ON and OFF buttons are displayed in this group. Use the buttons to open or shut the blinds.

## Basic Application

	The buttons are used to set the light colour when a DT8 device is used. If a group is used for Tunable White components, an input field is also displayed in this group in addition to a scroll bar. The colour temperature can be inserted in this input field along the Planckian curve. If the value 0 is inserted, the colour temperature is set on Mask.
	If the Mask button is activated, the settings in this group are maintained, irrespective of this scene.
	If the Off button is activated, the group in the scene is switched off.
	Use the Folder button to open the dialog box Load scene.
	Use the Save button to open the dialog box Save scene. The group settings are saved in the desired scene.
	Use the green arrow key to switch to the next page.

### Configuring scenes

One of the following settings are selected for each group in a scene:

- \_ Dim
- or -
- \_ Off
- or -
- \_ Mask

#### NOTICE

To configure a scene, only one operating device is to be assigned to a group because otherwise conflicts may occur.

One or several groups are defined.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Scenes (S)" button.  
-> The page "S..." is displayed.
3. Click on the Folder button to select the scene in which setting of the groups is to be saved.  
-> The dialog box "Select scene" is displayed.
4. Use the arrow keys to select the scene (S1 to S16) and confirm with OK.  
-> The scene is displayed.
5. Use the arrow keys of the scroll bar until the desired value is reached to set the dimming value for the first group.  
- or -  
Click on the Mask button so that settings of the scene do not influence the first group.

## Basic Application

- or -

Click on the Off button to switch off the first group.

6. Repeat steps 3 to 4 for the remaining three groups.
7. Click on the Save button.
  - > The dialog box Save as scene is displayed.
8. If necessary, change the scene in which the groups are to be saved and confirm with OK.
  - > The scene is saved.
9. Click on the green arrow key to define further groups for this scene and repeat steps 3 to 6 on the following two pages.
10. Click on the Folder button to define further scenes and use the arrow keys to select a new scene.
11. Repeat steps 2 to 7 if necessary.

### **i** NOTICE

A scene is not saved until when you click on the Save button and confirm the dialog box "Save as scene" with OK.

### 6.3.3. Sequence

Start, duration and repetition of scenes are saved in a defined order in a sequence. You can assign scenes to a sequence several times and in any order.


A sequence is ended if:

- \_ A schedule list, schedule or another sequence is called up.
- \_ The sequence is ended manually.
- \_ The end of the sequence is reached.

### **i** NOTICE

A scene will only achieve its final dimming level within a sequence if no other sequence is called up during the fade time.

The following operating elements are available to define a sequence:

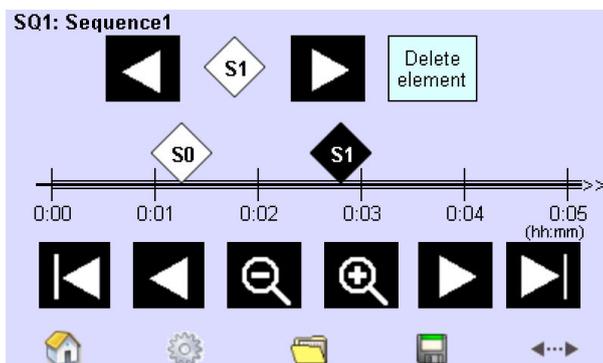

Element

Meaning / Function

## Basic Application

<b>SQ1: Sequence 1</b>	The sequence number (S1) is preset at the factory; the name (Sequence 1) can be assigned as desired.
	Use the arrow keys to select the scene that you want to include in the timeline.
	Use the button to remove the selected scene from the sequence.
	The timeline visualises: _ The duration of a sequence (maximal 23:59:59) _ The start of a scene _ The intervals between scenes _ The end of a scene
	Use the arrow keys to move the visible section of the timeline.
	Use the magnifier to enlarge or reduce the timeline section.
	Click on the Folder button to open the dialog box Load sequence.
	Click on the Save button to open the dialog box Save sequence. The current settings are saved in the desired sequence.
	Click on the Timeline button to set the duration and number of repetitions of a sequence.

### Configuring sequences


In a sequence, scenes are saved at a defined position on a timeline. The number of repetitions is determined with the digits 2 to 6 and Loop. If you enter 1, the sequence is only called up once. If you enter 2, it is called up twice and so on. Loop means that the sequence will be permanently repeated.

One or several scenes are defined.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Sequence" button.  
-> The SQ... page is displayed.
3. Click on the Folder button to select the sequence in which the scenes are to be saved.  
-> The dialog box "Load sequence" is displayed.
4. Use the arrow keys to select the sequence (SQ1 to SQ99) and confirm with OK.  
-> The sequence is displayed.

## Basic Application

- Click on the Timeline button to enter the duration of the sequence.  
-> The dialog box "Timeline:" is displayed.

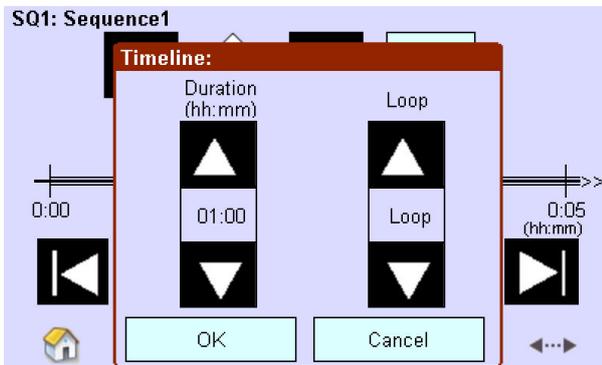

- Click on the arrow keys of the Duration field until the desired period is set.  
- or -  
Click on the number field. Select the duration in the dialog box Time entry and confirm with OK.
- Click on the arrow keys in the Loop field until the number of repetitions is set.
- Confirm the entries with OK.
- With the arrow keys and the magnifier, adjust the timeline section in such a way that the starting time for the scene is visible.
- Use the arrow keys to select the marker Scene (S1-S16).
- Move the marker Scene to the desired position on the timeline using Drag & Drop.
- Repeat steps 8 to 10 to enter further scenes.
- Click on the Save button.  
-> The dialog box Save sequence is displayed.
- If necessary, change the sequence in which the scenes are to be saved and confirm with OK.  
-> The sequence is saved with the current settings.
- Repeat steps 2 to 13 to define further sequences.

### **i** NOTICE

A sequence is not saved until you click on the Save button and confirm the dialog box "Save sequence" with OK.


### Setting the exact starting and fade time of a scene

After you have moved the scenes to the timeline you can set the exact starting and fade times for the individual scenes.

One or several scenes are saved in a sequence.

- Touch the marker Scene until the dialog box Details for scene is displayed.

## Basic Application

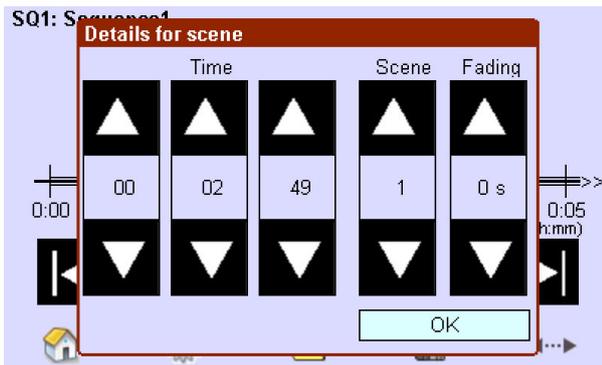


2. Click on the arrow keys in the first 3 fields Time (hh:mm:ss) until the desired starting time is set.
3. Check that in the fourth field Scene the scene is set for which this is to be the starting time. Click on the arrow keys as often as necessary until the desired scene is displayed.
4. In the fifth field Fading, click on the arrow keys until the desired fade time (0 to 90 sec) is displayed.
5. Confirm the settings with OK.
6. Click on the Save button.  
-> The dialog box Save sequence is displayed.
7. If necessary, change the sequence in which the scenes are to be saved and confirm with OK.  
-> The sequence is saved.
8. Repeat steps 1 to 7 to set the exact starting or fade time of scenes for further sequences.

### 6.3.4. Schedule (SDL)

A schedule comprises the time between 0:00:00 and 23:59:59. A schedule is a defined sequence of scenes and sequences. A schedule can be started manually or it can start automatically within an activated schedule list. The x/e-touchPANEL can save up to 7 schedules and thus no more than one schedule for each weekday.



You can use scenes and sequences several times and in any order in a schedule depending on the application. The duration of the sequences is visualised by the markers on the timeline.

The following operating elements are available to define a schedule:

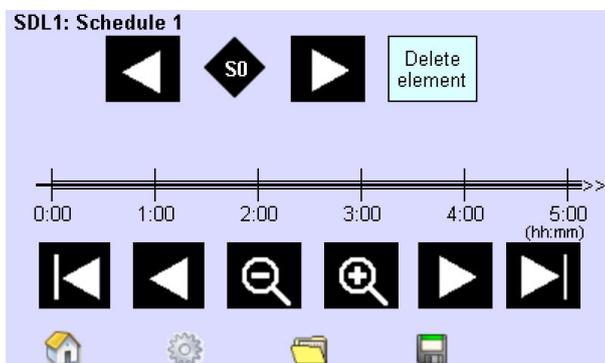

Element	Meaning / Function
<b>SDL1: Schedule 1</b>	The schedule number (SDL1) is preset at the factory; the name (Schedule 1) can be assigned as desired.

## Basic Application

	<p>Use the arrow keys to select the sequences and scenes that you want to include in the timeline. After S16, the marker Off is displayed. The marker Off ends a scene, sequence or schedule and can be set several times.</p>
	<p>Use this button to remove the selected scene or sequence from the schedule.</p>
	<p>The timeline visualises:</p> <ul style="list-style-type: none"> <li>_ The complete schedule (0:00 to 23:59)</li> <li>_ The start of a scene/sequence</li> <li>_ The duration of a scene/sequence</li> <li>_ The end of a scene/sequence</li> <li>_ The intervals between scenes/sequences</li> </ul>
	<p>Use the arrow keys to move the visible section of the timeline.</p>
	<p>Use the magnifier to enlarge or reduce the timeline section.</p>
	<p>The Folder button opens up the dialog box Select schedule.</p>
	<p>The Save button opens the dialog box Save schedule. The current settings are saved in the desired schedule.</p>

### NOTICE

If a sequence, schedule or schedule list is started in the Scheduler, the currently enabled function (Sequence, Schedule, Schedule list) is terminated.

### Configuring schedules

A schedule is defined by the order of scenes and sequences on the timeline.


Time and date are set.

Scenes and/or sequences are defined. The Main menu is visible.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Schedule (SDL)" button.

## Basic Application

-> The SDL ... page is displayed.

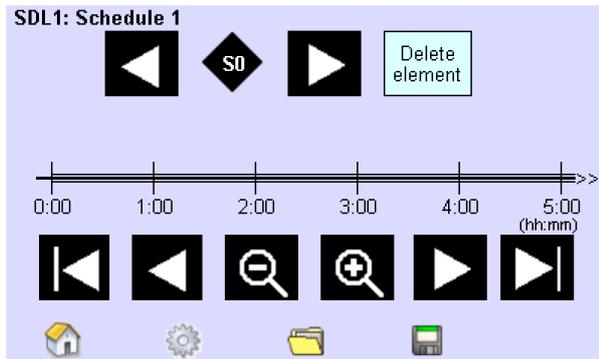

3. Click on the Folder button to select the schedule in which the scenes/sequences are to be saved.  
-> The dialog box Load is displayed.
4. Use the arrow keys to select the schedule and confirm with OK.  
-> The schedule is displayed.
5. Use the arrow keys to select the marker Scene or Sequence.
6. Move the marker Scene or Sequence to the desired position on the timeline using Drag & Drop.
7. Repeat steps 4 to 5 to enter further scenes or sequences.
8. Click on the Save button.  
-> The dialog box Save is displayed.
9. If necessary, change the schedule in which the scenes/sequences are to be saved and confirm with OK.  
-> The schedule is saved.
10. Repeat steps 2 to 8 to define further schedules.

### **i** NOTICE

A schedules is not saved until you click on the Save button and confirm the dialog box Save schedule with OK.

### **i** NOTICE

The exact starting time of a sequence is set in the same way as for a scene (see "[Setting the exact starting and fade time of a scene](#)", p. 64").

### Loading or checking a schedule

Time and date are set.

Scenes and/or sequences are defined.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the Schedule (SDL) button.  
-> The SDL ... page is displayed.

## Basic Application

3. Click on the Folder button.  
-> The dialog box "Select schedule" is displayed.
4. Use the arrow keys to select the schedule and confirm with OK.  
-> The schedule is displayed on the timeline.
5. Change and save the schedule as required.

### 6.3.5. Configuring a schedule list

Assign the schedules that you have defined to the days of the week to create a continuous, uninterrupted schedule list. The first schedule is assigned to all weekdays in the factory setting.

One or several schedules are defined.

The Main menu is visible.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the Schedule list (SDLL) button.



3. Click on the black arrow key.  
-> The selection box is displayed showing SDL1 to SDL7 and Off.
4. Select the schedule.  
- or -  
Select Off.
5. Repeat steps 2 to 5 for each weekday.  
-> The schedule list is saved without confirmation.

#### NOTICE

A schedule list is started, ended or interrupted in the "Home" menu (see "Manually switching a sequence, schedule or schedule list, p. 81").

## Colour Application

### 6.4. Colour Application

This chapter only explains the operating steps that are different from the Basic Application.

The chapter contains the following topics:

- \_ Changing the Application to Colour
- \_ Addressing and zone assignment
- \_ Colour sequences

The following topics are performed identically in both Applications. They are explained at the points indicated.

- \_ Configuring scenes (see "[Configuring scenes](#), p. 61").
- \_ Configuring schedules (see "[Schedule \(SDL\)](#), p. 65").
- \_ Configuring a schedule list (see "[Configuring a schedule list](#), p. 68").

#### 6.4.1. Changing Applications


Changing the Application is described in the section "[Selecting the Application](#), p. ".

When the Application is changed, the »x-touch« software is automatically restarted.

#### 6.4.2. Addressing and zone assignment

Addressing Addressing of the operating devices is performed in the same way in the Colour and Basic Applications (see "[Addressing and grouping](#), p. 54").

Zone assignment In the »x-touch« software, each RGB-/RGBW operating device is assigned to the colour scale (red, green, blue, white) of a zone using Drag & Drop. Four zones with 4 colour scales are available. Each colour scale of a zone corresponds to a group.

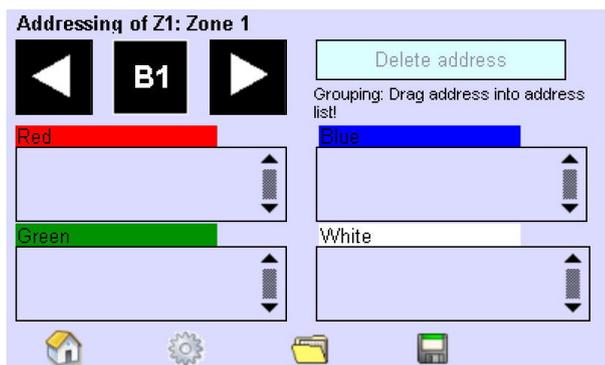

Since the three groups Red, Green and Blue are necessary for colour mixing and only the group White is not required, only the groups White (max. 4 groups) can be controlled individually. For basic lighting, e.g. the group White of the four zones is used.

The groups White can be dimmed, masked or switched off and saved in scenes in a similar way to the Basic Application. Depending on the configuration, the groups can be switched and dimmed individually in the Home menu (see "[Creating a layout for the Home menu](#), p. 76").


#### Addressing RGBW operating devices and assigning them to zones

The descriptions of the procedure and addressing methods System extension and Reinitialization can be found in the chapter "[Addressing and grouping](#), p. 54".

## Colour Application

The Main menu is visible.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Addressing/grouping" button.  
-> The dialog box "Addressing method" is displayed.
3. Activate the System extension or Reinitialization check box.
4. Click on the "Next >" button.  
-> The x-touch software indicates the number of operating devices it has detected.
5. When the message Search completed is displayed, click on the Complete button.  
-> Each operating device is addressed.  
-> The page Addressing of Z ... is displayed.

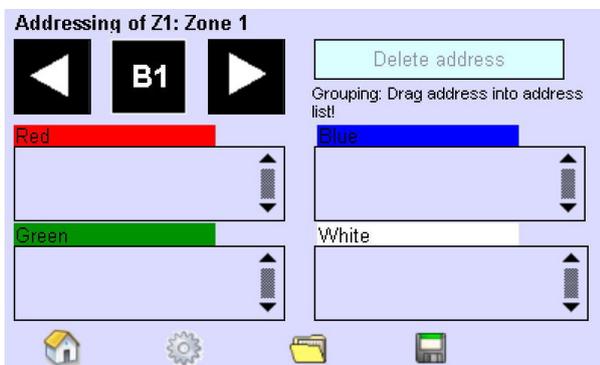

6. Click on the Folder button to select the zone in which the operating devices are to be saved.  
-> The dialog box Select zone is displayed.
7. Use the arrow keys to select the zone and confirm with OK.  
-> The zone is displayed.
8. Use the arrow keys to select the address of the operating device to be assigned to the zone.
9. Move the address of the operating device (1) into the group field representing the respective colour using Drag & Drop.  
-> The address is displayed in the group field of the currently selected zone.
10. Repeat steps 8 and 9 until the operating devices of this zone are assigned to one of the four group fields.
11. Click on the Save button.  
-> The dialog box Save zone is opened.
12. If necessary, change the zone in which the operating devices are to be saved and confirm with OK.  
-> The zone is saved.
13. Repeat steps 5 to 12 until each operating device is assigned a zone.

### **i** NOTICE

The zone assignment is only saved when you click on the Save button and confirm with OK in the dialog box.

## Colour Application

### 6.4.3. Configuring colour sequences

In a colour sequence, scenes (white light) and colour events (RGB (W)) are saved at a defined position on a timeline. The number of repetitions of the colour sequence is selected with the digits 2 to 6 and Loop. If you enter 1, the sequence is only called up once. If you enter 2, it is called up twice and so on. Loop means that the colour sequence will be permanently repeated.

Only after a colour event has been assigned to a colour sequence can the event be configured.

A colour sequence is ended if:


- \_ Another colour sequence/scene is called up.
- \_ The colour sequence is ended manually.
- \_ The end of the colour sequence is reached.

1. Click on the "Main menu" symbol.

-> The "Main menu" is displayed

2. Click on the Colour sequence (SQ) button.

-> The SQ... page is displayed.

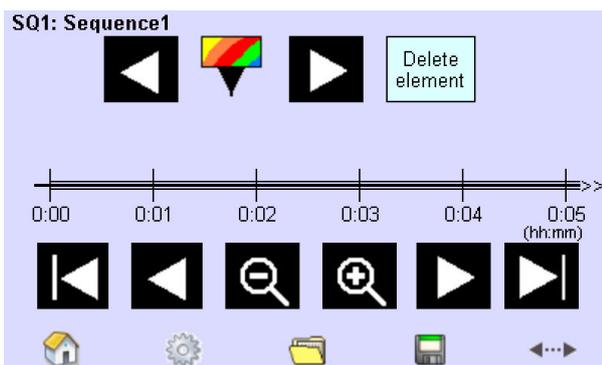

3. Click on the Folder button to select the colour sequence in which the colour events are to be saved.

-> The dialog box "Load sequence" is displayed.

4. Use the arrow keys to select the colour sequence and confirm with OK.

-> The sequence is displayed.

5. Click on the Timeline button to enter the Duration of the colour sequence.

-> The dialog box "Timeline" is displayed.

6. Click on the arrow keys of the Duration field until the desired period is set.

- or -

Click on the number field. Select the duration in the dialog box Time entry and confirm with OK.

7. Click on the arrow keys in the Loop field until the number of repetitions is set.


8. Confirm the entries with OK.

9. With the arrow keys and the magnifier, adjust the timeline section in such a way that the starting time for the colour event is visible.

## Colour Application

Move the marker Colour event to the desired position on the timeline using Drag & Drop.

-> The start of the Colour event marker is defined.

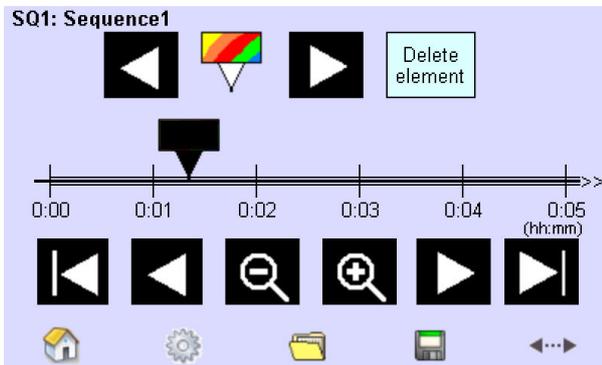

10. Repeat steps 8 to 9 to enter further colour events.

11. Click on the Save button.

-> The dialog box "Save sequence" is displayed.

12. If necessary, change the colour sequence in which the colour events are to be saved and confirm with OK.

-> The colour sequence is saved with the current settings.

13. Repeat steps 2 to 12 to define further colour sequences.

### 6.4.4. Configuring colour events

This chapter explains how to configure the exact starting time, fade time and colour of the colour event. You can select the colour in a colour table or enter the individual values for the RGBW colours (red, green, blue, white) numerically.

1. Click on the "Main menu" symbol.

-> The "Main menu" is displayed

2. Click on the "Colour sequence (SQ)" button.

3. Touch the marker Colour event on the timeline until the dialog box Details for colour event is displayed.

-> The dialog box "Details for colour event" is displayed.



4. To determine the RGB value using a colour table, click on a colour in the first RGB tab.

- or -

## Colour Application

To enter the RGB value numerically, enter the RGB values in the second tab.

- or -

To enter the RGBW value numerically, enter the RGBW values in the third tab.

5. Activate the Zone check box (Z1 to Z4) to assign the colour event to one or several zones.
6. To define the exact duration and fade time, click on the Timing, Fading button. Use the arrow keys to select the values and confirm with OK.
7. Confirm the entries with OK.
8. Repeat steps 2 to 6 to define further colour events.
9. Confirm the settings with OK.  
-> The colour event in the colour sequence is saved.

## Plug Application

### 6.5. Plug Application

The Application mode is designed to be easy to use. All operating steps have already been explained in the previous sections.

#### 6.5.1. Changing the Application

Changing the Application is described in the section "[Selecting the Application](#), p. ". When the Application is changed, the »x-touch« software is automatically restarted.

#### 6.5.2. Addressing

Addressing is done on a connector on the operating device. Addressing is therefore not possible and necessary.

#### 6.5.3. Zone assignment

There is only 1 zone with 4 colour scales in the Plug Application. Each colour scale corresponds to a group. Depending on the configuration, the groups can be switched and dimmed individually in the Home menu (see "[Creating a layout for the Home menu](#), p. 76").

The following topics are explained at the points indicated.

- \_ [Configuring a schedule list](#) (see "[Configuring a schedule list](#), p. 68").
- \_ [Configuring a colour event](#) (see "[Configuring colour events](#), p. 71").

## Operation in the Home menu

### 6.6. Operation in the Home menu

In the Home menu, lighting situations are called up manually using freely configurable buttons.

#### **i** NOTICE

The following rules apply for operation in the Home menu:

- \_ If an action is called up manually, this is independent of time-controlled situations.
- \_ Manually calling up a scene/group interrupts a sequence or schedule only until the following scene of the sequence or the following scene or sequence of the schedule starts.
- \_ If a schedule/sequence is called up manually, the currently active schedule/sequence is ended. The manually called up function is active until it is manually switched off or until it ends.


#### 6.6.1. Overview

The number of pages in the Home menu depends on the Application (see "Configuring buttons in the Home menu, p. 78") and the settings in the Configuration menu (see "Creating a layout for the Home menu, p. 76").


The following chapter gives an overview of all buttons that can be activated in the Home menu. The Scheduler is described in the chapter "Manually switching a sequence, schedule or schedule list, p. 81".

#### Basic Application

- \_ Switching a maximum of 4 pages with 4 scenes on and off and dimming them.
- \_ Switching a maximum of 2 pages with 8 scenes.
- \_ Switching a maximum of 4 pages with 4 groups on and off and dimming them.

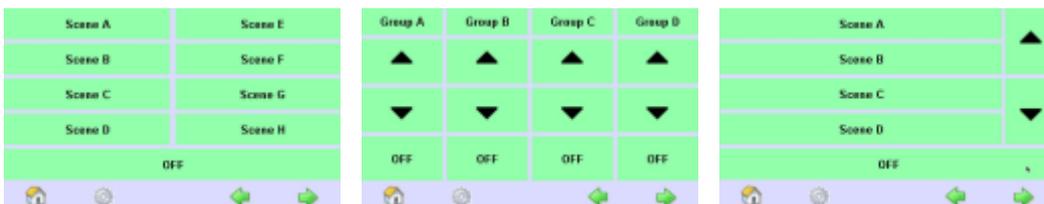


- \_ One page with 16 buttons to switch the groups on and off.
- \_ One page with the ON, OFF and Clean buttons.
- \_ One page with the selection list and Scheduler buttons:

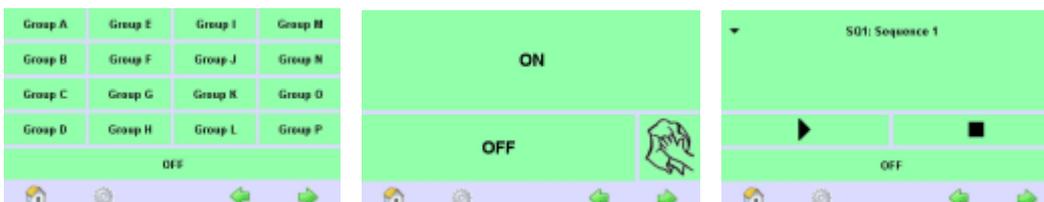


## Operation in the Home menu

### Colour Application


- \_ Switching a maximum of 4 pages with 4 scenes and dimming them.
- \_ One page with 8 colour effects for 4 zones for each colour scene.

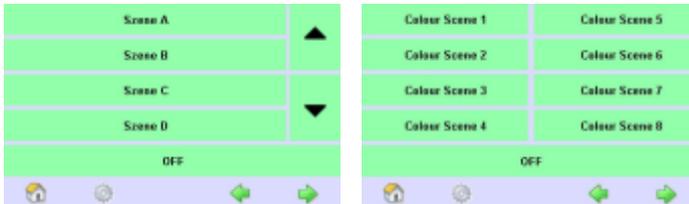

- \_ One page with 2 colour effects for a maximum of 4 zones for each colour effect.
  - \_ One page with 4 colour effects for a maximum of 4 zones for each colour effect.
- Switching a maximum of one page with 4 groups on and off and dimming them (group White in each of the 4 zones).

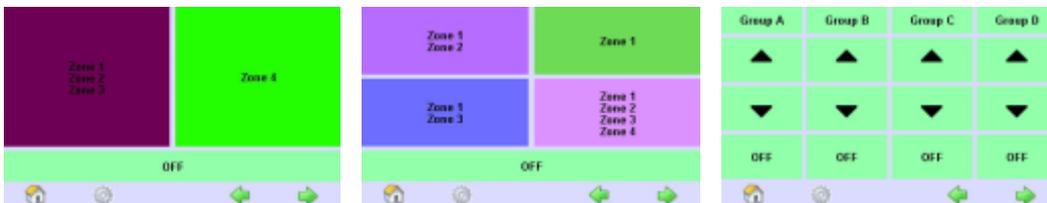

- \_ One page with the ON, OFF and Clean buttons.
- \_ One page with the selection list and Scheduler buttons:

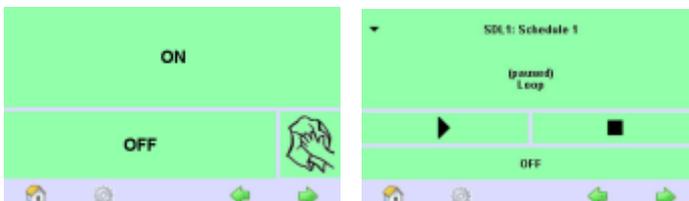

### 6.6.2. Creating a layout for the Home menu


The Home menu is configured in such a way that only the buttons you want to appear are displayed. Activate the buttons in the Layout tab. All buttons are activated at the factory.

In addition, you can change the factory-set functions of the buttons (see "[Configuring buttons in the Home menu](#), p. 78") and protect the configurations with a password if required (see "[Password protection](#), p. 13").


Use the Dim function to activate the dimming function for the buttons in the first column.

Use the Scheduler function to start and stop time-controlled actions manually in the Home menu. The Clean button deactivates the touchscreen for 20 seconds. The ON and OFF buttons can be configured, e.g. switch all operating devices on or off or a frequently used lighting situation, such as cleaning or night lighting, are assigned to them (see "[Configuring buttons in the Home menu](#), p. 78").

## Operation in the Home menu

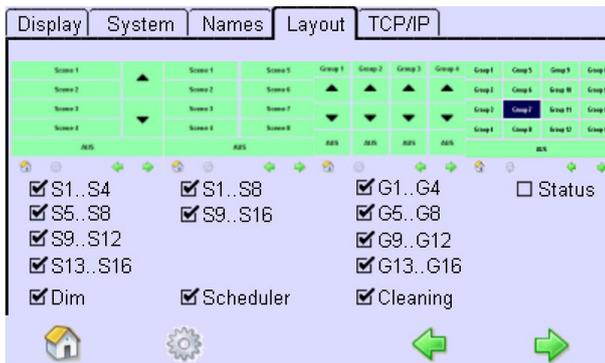

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed
3. Click on the "Layout" tab
4. -> The "Layout" tab is displayed
5. Activate the check boxes for the functions you want to be displayed as buttons in the Home menu.  
-> When activating the check box Dim, the dialog box Config. DIM button is displayed

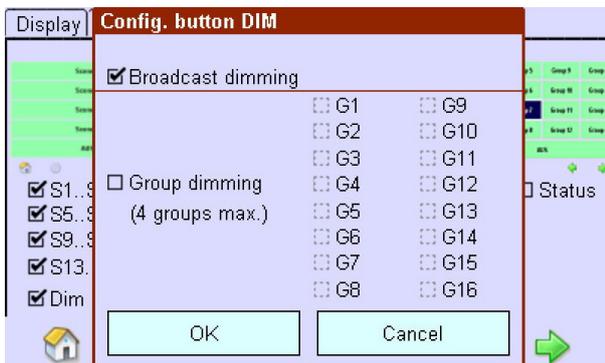

6. Activate the check box Dim Broadcast to dim all operating devices.
7. Activate the respective check boxes to dim one or several groups.  
-> The operating devices that are set can be dimmed using the buttons in the Home menu.

### **i** NOTICE

The Dim buttons can only be configured in the Basic Application.  
Tridonic recommends activating the Dim buttons for a maximum of 4 groups to ensure that there is no time delay with the dimming.

## Operation in the Home menu

### 6.6.3. Configuring buttons in the Home menu

The following table lists the optional configurations of the buttons depending on the Application. The Dim buttons can only be configured in the Basic Application. It is only possible to dim the white light (groups A to D) in the ColourApplication.

Button / Option in the Basic Application	Button / Option in the Colour Application
Scene <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Default (factory setting)</li> <li>_ Special:               <ul style="list-style-type: none"> <li>_ SDL1 to SDL6</li> <li>_ SQ1 to SQ6</li> <li>_ Schedule list</li> <li>_ Stop</li> </ul> </li> </ul>	Scene <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Default (factory setting)</li> <li>_ Special:               <ul style="list-style-type: none"> <li>_ SDL1 to SDL6</li> <li>_ SQ1 to SQ6</li> <li>_ Schedule list</li> <li>_ Stop</li> </ul> </li> </ul>
-	Zone <ul style="list-style-type: none"> <li>_ 1 colour for 1 to 4 zones</li> </ul>
-	Colour scene <ul style="list-style-type: none"> <li>_ 4 zones (1 colour for each zone)</li> </ul>
OFF (on Clean page) <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Broadcast OFF (switch off all operating devices)</li> <li>_ Group OFF               <ul style="list-style-type: none"> <li>_ G1 to G16</li> </ul> </li> </ul>	OFF (on Clean page) <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Broadcast OFF (switch off all operating devices)</li> <li>_ Zone OFF               <ul style="list-style-type: none"> <li>_ Zone 1 to 4</li> </ul> </li> </ul>
ON (on Clean page) <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Broadcast 100% (switch on all operating devices)</li> <li>_ Group 100%               <ul style="list-style-type: none"> <li>_ G1 to G16</li> </ul> </li> </ul>	ON(on Clean page) <ul style="list-style-type: none"> <li>_ No function</li> <li>_ Broadcast 100% (switch on all operating devices)</li> <li>_ Zone 100%               <ul style="list-style-type: none"> <li>_ Zone 1 to 4</li> </ul> </li> </ul>

## Operation in the Home menu

OFF (on Scene, Group, Scheduler page)

- \_ No function
- \_ Broadcast OFF (switch off all operating devices)
- \_ Group OFF
  - \_ G1 to G16

OFF (on Scene, Zone, Colour scene, Group,

Scheduler page)

- \_ No function
- \_ Broadcast OFF (switch off all operating devices)
- \_ Zone OFF
  - \_ Zone 1 to 4

### **i** NOTICE

In the Home menu, the buttons are displayed with the names that you have assigned to them in the Names tab of the Configuration menu.


It is also possible to assign application-specific graphics to the buttons (see "[Loading application-specific buttons](#), p. 83").

### Configuring the Scene button

Sequences or schedules are defined.


The layout for the Home menu has been created.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. To assign a new function to a button, click on the button (e.g. Scene1) until the dialog box Config. button is displayed.

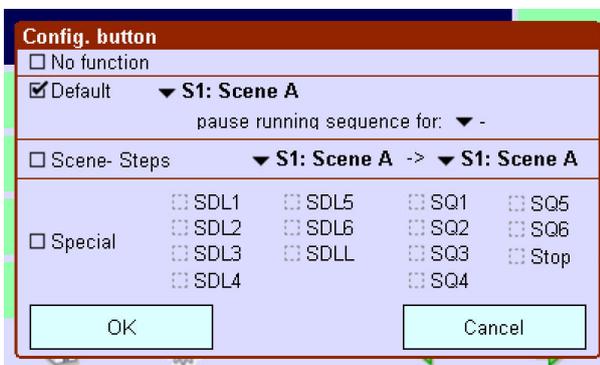


3. To remove the function from the button, activate the check box No function.  
- or -  
To assign a scene to the button, activate the check box Scene and select a scene.  
- or -  
To assign a lighting situation to the button, activate the check box Special and then activate the check box Schedule list SDLL, Schedule SDL, Sequence SQ or Stop.
4. Activate the check box Scene steps to define that the sequence of scenes is run one after another.
5. Select a scene in the dropdown menu that is to be the start and end of the sequence.

## Operation in the Home menu

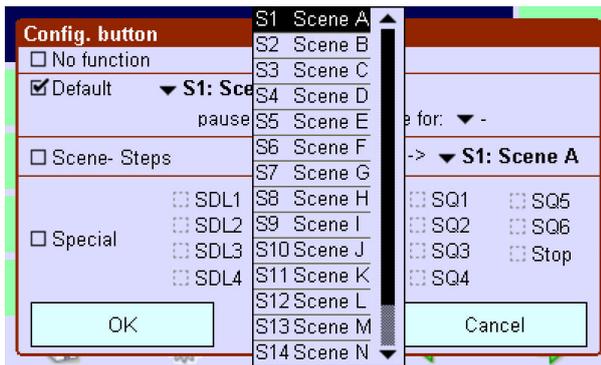

6. If this scene is only to be called up briefly and to interrupt the current sequence (e.g. cleaning of the room), click on the black arrow key next to Stop current sequence for: and select the duration of the interruption.

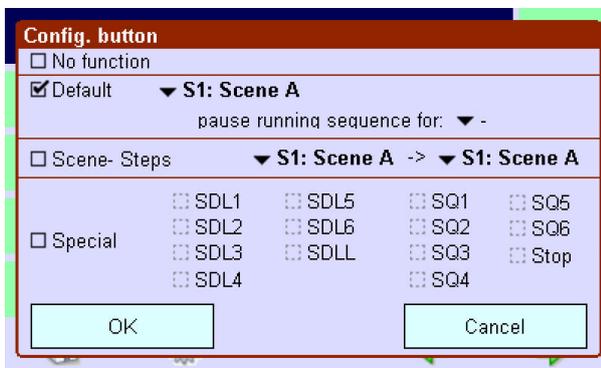

7. Confirm the entry with OK.  
-> The button with the desired function and designation is displayed in the Home menu.

### Configuring the Colour scene button

Configuring the Colour scene buttons is suitable for applications where you want to call up different colour lighting situation in zones by clicking just one button.

To assign a new function to a Colour scene button, there are several options for each of the four zones:

- \_ Colour setting
- \_ Masking
- \_ Switching off
- \_ Fading

The layout for the "Home" menu has been created.

The Colour scene buttons are visible in the "Home" menu.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed  
-> The Colour scene buttons are visible in the "Home" menu.
2. Click on the button (e.g. Colour scene1) until the dialog box with the four zones is displayed.

## Operation in the Home menu



3. Click on Zone to set the colour for the first zone.  
-> The dialog box Details for colour event is displayed.




4. Enter the colour using one of the three tabs.  
- or -  
Activate the check box MASK to leave this zone unchanged.  
- or -  
Click on the OFF button to switch off all operating devices in this zone.
5. To switch the operating devices in the colour event that are assigned to the White zone, activate the check box RGBW.
6. To set fading, click on the Timing, Fading button, set the time and confirm with OK.
7. Confirm the entries with OK.  
-> The first zone of the colour scene is set.
8. Repeat steps 2 to 6 to set the other three zones.
9. Click on the Home button.  
-> The Colour scene button is displayed in the Home menu with the desired lighting situation.


### 6.6.4. Manually switching a sequence, schedule or schedule list

You can operate a sequence, schedule or schedule list manually on this page.

The following operating elements are available:

## Operation in the Home menu

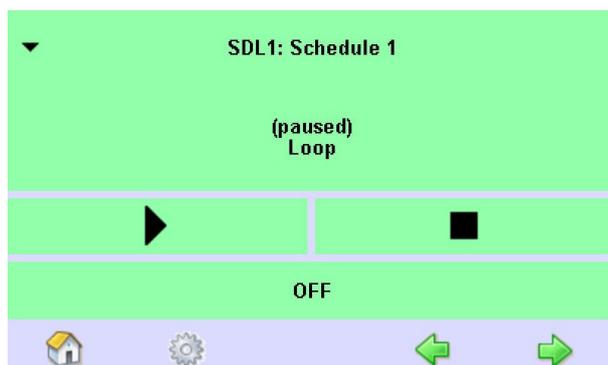

Button	Operating function
	Opens the dialog box for selecting a lighting situation (sequence 1 to 99, schedule 1 to 7 or schedule list).
	Shows the lighting situation that is called up using the Start/Pause, Stop and Off buttons.
	Displays the status.
	Start: Calls up the lighting situation and starts the time-controlled sequence.
	Pause: Interrupts the lighting situation.
	Stop: Ends the lighting situation (00:00:00).
	Off: Switches off the lighting situation and ends the sequence.
	Indicates that a time-controlled lighting situation is active. The button is displayed in all menus and calls up the Scheduler in the Home menu.

1. Click on the Home button.
2. Click on the arrow keys until the Scheduler page is displayed.  
-> The dialog box Load is displayed.
3. Click on the arrow keys until the desired lighting situation is displayed and confirm with OK.
4. Click on the Start button to call up the lighting situation.


## Operation in the Home menu

### 6.6.5. Stop running sequence, schedule or schedule list

It is possible to stop running sequences or schedules or schedule lists with other control modules (e.g. DALI XC, DALI TOUCHPANEL 02)

when sending Broadcast OFF or MAX command.

#### How to

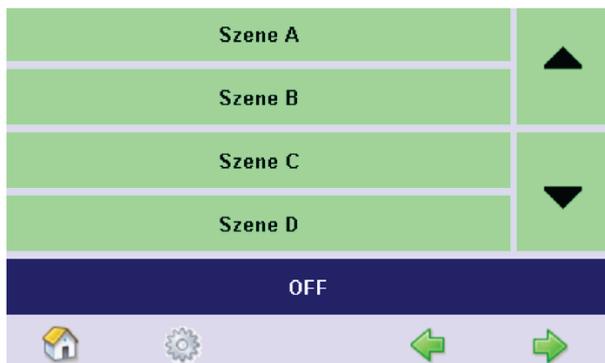

Got to the [Home menu](#)

And [press OFF](#) field for [>3 seconds](#).



In the new Window you can select the field

OFF, MAX stops Seq.

OFF, MAX stops Seq.

### 6.6.6. Loading application-specific buttons and screen saver

The design of the buttons of the Home menu can be changed to suit the specific application in an image processing program. The bitmap template is available on the Internet ([www.tridonic.com](http://www.tridonic.com) > Services > Software > x-e-touchPANEL 02).

#### NOTICE

Only use the UI\_Layout.png template and create a new design for the buttons as required. Do not change file names, sizes or file properties. Do not use any mobile logos.

### 6.6.7. Loading application-specific buttons

The design of the menu Home buttons can be changed in an image processing program. The template for the bitmap is available on the Internet ([www.tridonic.com](http://www.tridonic.com) > Services > Software > x-e-touchPANEL 02).

It is also possible to download the UI\_Layout.png via the ethernet connection on the panel.

## Operation in the Home menu

### 6.6.8. Loading application-specific screen saver

#### NOTICE

The screen saver can be individually changed. More information can be found at chapter "[Replace screensaver image, p. 91](#)" and "[Uploading a screen saver, p. 103](#)".

#### NOTICE

Only use the UI\_Layout.png template and create a new design for the buttons as required.  
Do not change file names, sizes or file properties. Do not use any mobile logos.

## Interfaces

### 7.1. Loading the software update

Updates are available to download from the Tridonic homepage: [www.tridonic.com](http://www.tridonic.com) > Service > Software

The following steps are necessary to load a software update onto the x/e-touchPANEL:

- \_ Determine the current program version, see "[Determining device names and the program version, p. 16](#)".
- \_ Check if a higher version is available and download it.
- \_ Establish a USB connection, see "[USB interface, p. 87](#)".
  - or -
  - Establish an Ethernet connection, see "[Setting an IP address on the x/e-touchPANEL, p. 98](#)".
- \_ Install the application software update via a USB connection, see "[USB interface, p. 87](#)".
  - or -
  - Install the application software update via an Ethernet connection, see "[Uploading/downloading files and test protocols, p. 100](#)".

#### NOTICE

##### Software updates



The software for the x/e-touchPANEL 02 is continuously developed and improved. Software updates are provided to our customers free of charge.

To make sure that you always use the latest software version, you can register at [www.tridonic.com/xe](http://www.tridonic.com/xe).

As a registered user you will be notified by email whenever a new update is available.

To register, follow the link [www.tridonic.com/xe](http://www.tridonic.com/xe) or scan the QR code with your smartphone.

## Interfaces

### 7.2. Overview

The x/e-touchPANEL has a USB interface and enables the transmission of:

- \_ Test protocols (e.g. for archiving)
- \_ Application software updates for the x/e-touchPANEL
- \_ Configuration files

#### NOTICE

The configuration file of a x/e-touchPANEL contains the system settings (including the addresses of emergency lighting, device/test group names for the EMERGENCY Application or addresses of operating devices, names of devices, groups, scenes, etc. for DALI Applications) and enables the configuration to be saved.  
It is also a backup file for the system settings of the EMERGENCY Application.

The x/e-touchPANEL also has an Ethernet interface that enables configuration and operation of the system via a connected PC or laptop. The display of the touchscreen and of the virtual touchscreen on the PC/laptop is synchronised in real time. By transmitting the current statuses of several panels, the entire system can be monitored.


#### NOTICE

##### **em-LINK software**

The software em-LINK allows for easy monitoring of e/x-touchPANEL networks. The software can be downloaded free of charge at [www.tridonic.com/com/en/software-em-link.asp](http://www.tridonic.com/com/en/software-em-link.asp).

## Interfaces

### 7.3. USB interface

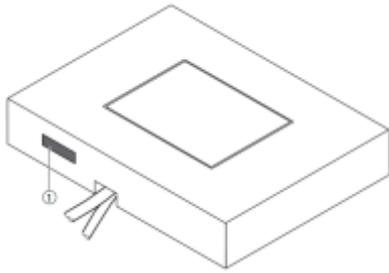

(1) USB interface on the base of the device

#### **i** NOTICE

Take care you use a USB memory stick that was formatted with FAT or FAT32. Otherwise, there is risk that the stick won't be correctly recognised!

FAT32 is limited to 32 gigabytes of storage capacity. To format a USB memory stick that has more than 32 gigabytes using FAT32, you must first create a partition with less than 32 gigabytes on the USB stick.

#### 7.3.1. Registration instructions

The software for the x/e-touchPANEL 02 is continuously developed and improved. Software updates are provided to our customers free of charge.

To make sure that you always use the latest software version, you can register at [www.tridonic.com/xe](http://www.tridonic.com/xe).

As a registered user you will be notified by email whenever a new update is available .

1. Enter [www.tridonic.com/xe](http://www.tridonic.com/xe) in a web browser .
  - > The registration screen appears.
  - > The correct software is automatically selected at the drop down menu "Software".
2. Enter personal data in the registration form.

## Interfaces

**TRIDONIC**  
Software Download

**Software Download**  
Before you can download the software you need to register. To do this, please fill in the form below. Registration and software downloads are free of charge. When you have registered you will be sent an email with a download link. You can then use this link to download the software once.

**Registration**  
Please fill in all the fields in the form. There is no need to enter information in any of the fields marked (optional).

Title: Mr

First name: [text box]

Surname: [text box]

Company: [text box]

Address, city and post code (optional): [text box]

Country: (please select) [dropdown]

Email: [text box]

Software: x/e-touchPANEL Software V1.0.1 (4 MB) [dropdown]

Please inform me of future updates to the software selected above (optional)

[Delete entries] [Register]

**Notes on data protection**  
When you have completed the form and pressed the "Register" button the data you have entered will be stored electronically at Tridonic. All the data will be processed in strict confidence and will not be used for any advertising purposes and will not be passed on to third parties. It will be used exclusively for verifying downloads and for statistical purposes.

- Click on button "Register" to submit data.  
-> An E-mail with a download link will be sent to the address entered at "Email".
- Click on download link.  
-> The software (zip file) is downloaded automatically.

### 7.3.2. Update firmware via the USB interface

The software (zip file) has been downloaded completely:

Name	Size	Type
xetouch_software_V1.07	6.654 KB	7z Archive

- Double click zip file "xetouch\_software\_Vxxx" to extract the software (Vxxx stands for a specific version number).  
-> The Zip file "xetouch\_Vxxx" is displayed:

Name	Size	Type
Release Notes SW_1.07	1.648 KB	Adobe Acrobat Document
UI_Layout	13 KB	PNG Image
xetouch_V107	4.994 KB	Compressed (zipped) Folder


- Extract the zip file "xetouch\_Vxxx".
- Double click the folder "xetouch\_Vxxx" to extract it.  
-> The folder "AutoRun" is displayed.
- Copy the folder "AutoRun" to the top level of a USB memory stick.

Name	Size	Type
AutoRun		File Folder

- Insert the USB memory stick into the USB interface of the x/e-touchPANEL.

## Interfaces

-> The screen "USB Loader App" is displayed.

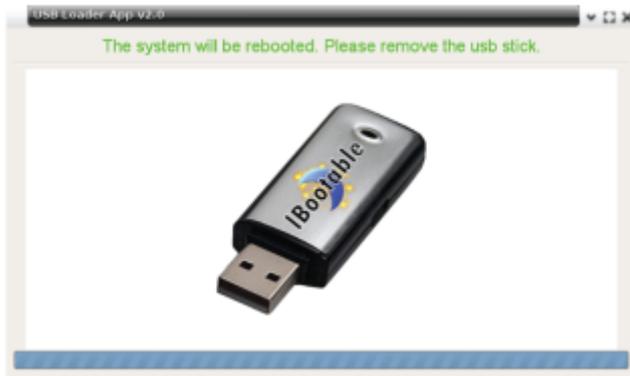

-> Data is transmitted.

-> A message appears "Please remove the usb stick".

6. Remove USB memory stick from USB interface.

-> x/e-touchPANEL is restarted.

-> After restart updating the firmware is completed.

### NOTICE

During restart, the mains supply must not be disconnected!

## Interfaces

### 7.3.3. Load customised design (only available in Basic, Colour, Plug Applikation)


1. You have already registered at [www.tridonic.com/xe](http://www.tridonic.com/xe) and downloaded the software.
2. Customised design template Design UI\_Layout.png can be found in extracted folder.

Name	Size	Type
Release Notes SW_1.07	1.648 KB	Adobe Acrobat Doc...
UI_Layout	13 KB	PNG Image
xetouch_V107	4.994 KB	Compressed (zippe...

3. Use image editing programm to change the design of the home menu buttons.
4. Don't use any other templates but UI\_Layout.png! Don't change file names, sizes or properties! Don't use animated logos!
5. Upload the changed UI\_Layout.png file onto the /AutoRun/LTUpdate/home/resource/ directory of a USB memory stick.

Address		
E:\AutoRun\LTUpdate\home\resource		
Name	Size	Type
UI_Layout.png	16 KB	PNG Image

6. Insert USB memory to the USB interface of the x/e-touchPANEL.  
-> The file UI\_Layout.png is automatically copied to the x/e-touchPANEL.
7. Go to xetouch software of the the x/e-touchPANEL.
8. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
9. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
-> The "Display" tab is displayed.

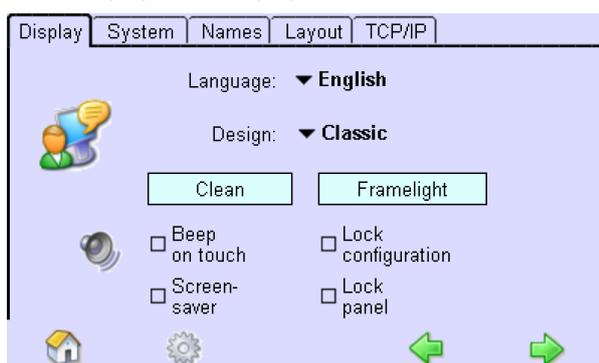

10. Click button "Design:"  
-> A drop down menu with four design options is displayed

## Interfaces



11. Choose option "User defined (png)".  
 -> Conversion of design is completed.  
 -> Customised design is displayed.


### 7.3.4. Replace screensaver image

x/e-touchPANEL allows loading a customer specific screensaver image, for example with a specific logo.

The image must be in .png format and have a size of 800x480 pixels. The screensaver is activated when the screen hasn't been touched for more than 2 minutes.

To change the screensaver image proceed as follows:

1. Create a file, name it 'screensaver.png' and copy it into the /AutoRun/LTUpdate/home/resource directory of a USB memory stick.



, p.


2. Insert USB memory stick into USB interface of the x/e-touchPANEL.  
 -> The screensaver image is automatically copied to the x/e-touchPANEL.

### 7.3.5. Save configuration file or testbook


The x/e-touchPANEL allows you to save the configuration file and/or the testbook. The procedure is the same for all Applications. The following description uses screenshots from the Emergency Application which can be different from the other Applications.

1. Insert a USB memory stick into the USB interface of the x/e-touchPANEL
2. Click on the "Main menu" symbol.  
 -> The "Main menu" is displayed


## Interfaces

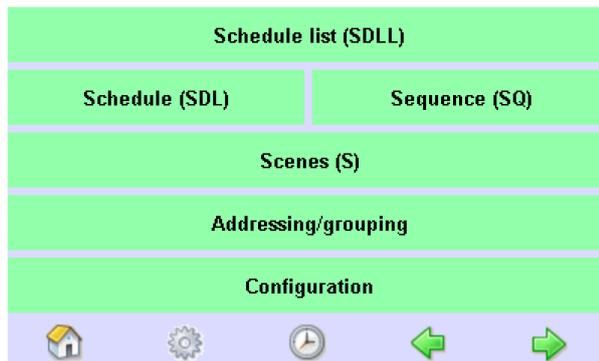

3. Click on the "Configuration" button
4. -> The "Configuration" page is displayed
5. Click on the "System" tab  
-> The "System" tab is displayed

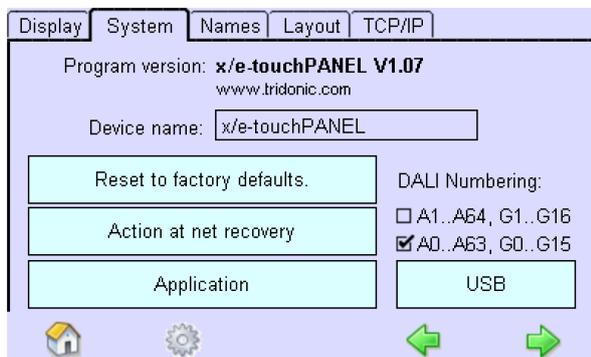

6. Click on the "USB" button  
-> The dialog box "USB backup" is displayed

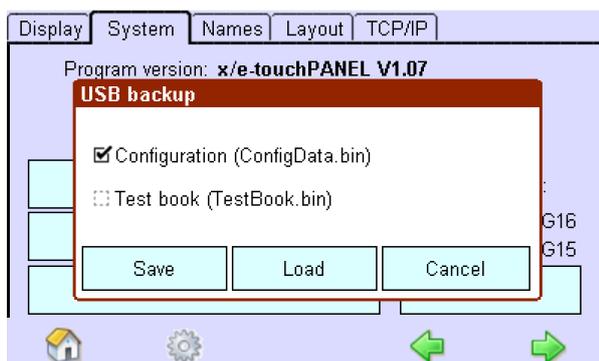

7. Activate checkbox "Configuration (ConfigData.bin)" to load configuration file to x/e-touchPANEL (all Applications).  
- and/or -  
Activate checkbox "Test book (TestBook.bin)" to load testbook to x/e-touchPANEL (only available in EMERGENCY Application).
8. Click button "Save" to confirm selection  
-> The configuration file (ConfigData.bin) and/or the testbook is copied to the USB memory stick.

## Interfaces




9. Confirm with click on OK.
10. Disconnect USB memory stick  
-> Configuration file and/or testbook is saved.


### 7.3.6. Load configuration file or testbook

The x/e-touchPANEL allows you to load the configuration file or the testbook via USB interface. The procedure is the same for BASIC, COLOUR, PLUG and EMERGENCY Application.

1. Load configuration file (ConfigData.bin) and/or testbook (TestBook.bin) to USB memory stick.
2. Insert USB memory stick to USB interface of the x/e-touchPANEL.

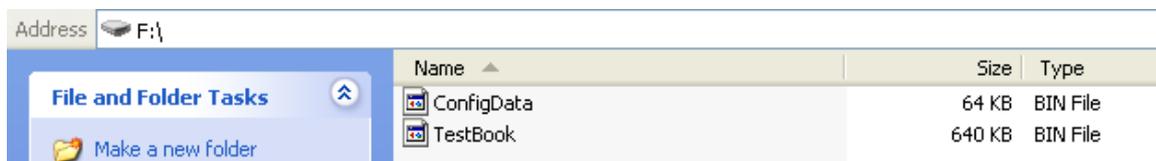


3. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed

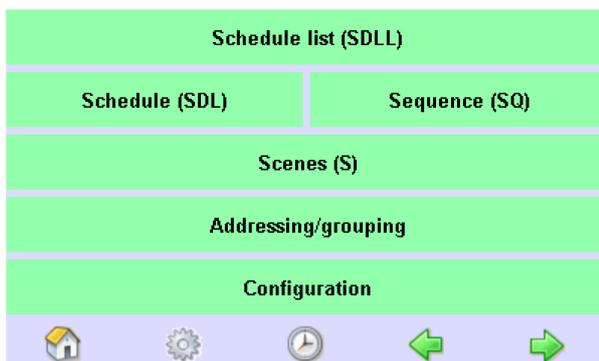


4. Click on the "Configuration" button  
-> The "Configuration" page is displayed
5. Click on the "System" tab  
-> The "System" tab is displayed

## Interfaces

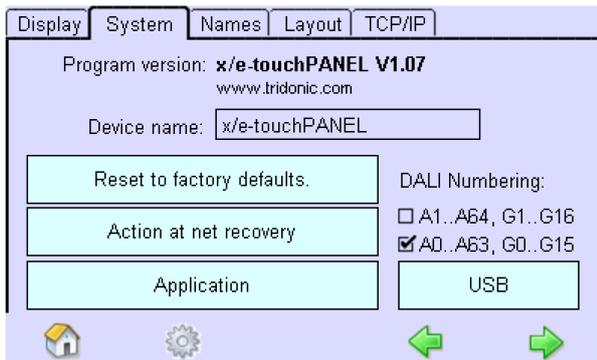

6. Click on "USB" button

-> The dialog box "USB backup" is displayed.

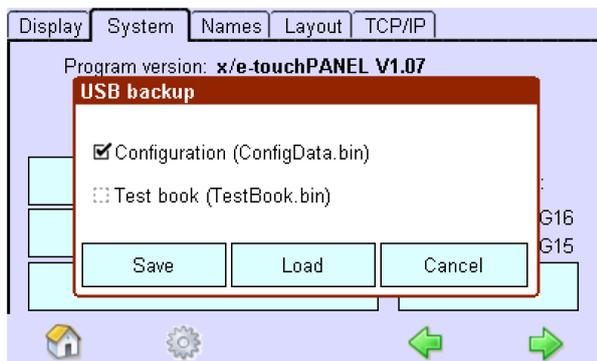

7. Activate checkbox "Configuration (ConfigData.bin)" to load configuration file to x/e-touchPANEL (all Applications).


- or -

Activate checkbox "Test book (TestBook.bin)" to load testbook to x/e-touchPANEL (only available in EMERGENCY Application).

8. Click button "Configuration".

9. Click button "Load".

-> The dialog box "Reboot" is displayed.

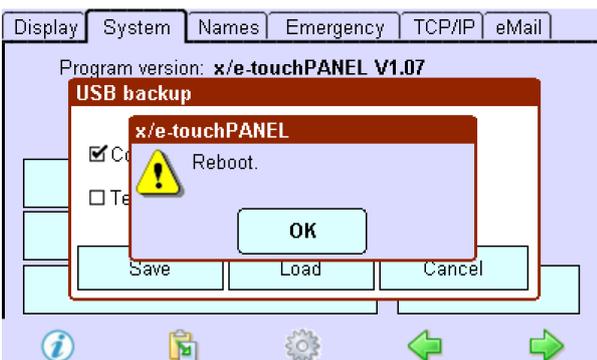

10. Confirm with OK.

-> x/e-touchPANEL is restarted.

-> After restart the configuration file and/or testbook is loaded.

## Interfaces

### 7.3.7. Download testbook (only EMERGENCY Application)

The x/e-touchPANEL allows you to save the testbook.

Proceed as follows.


1. Insert a USB memory stick into the USB interface of the x/e-touchPANEL.
2. Click on the "Test protocol" symbol.  
-> The "Test protocol" is displayed



3. Click on "Save to USB" symbol:



-> The dialog box "Write to file on USB stick:" is displayed.

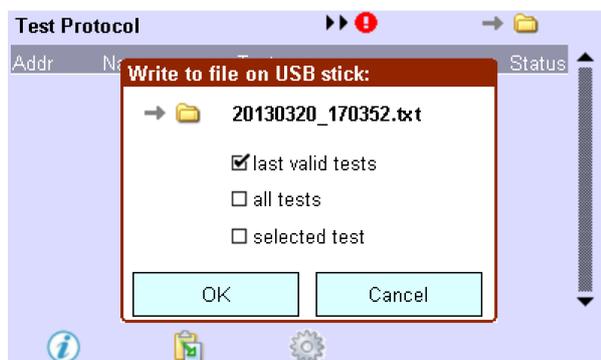


4. Choose one of the options: "last valid tests", "all tests" or "selected test".
5. Confirm with OK.  
-> The test protocol was saved on the USB memory stick.

### 7.3.8. Rename Groups, Scenes, Sequences, Schedules


It is possible to rename groups, scenes, sequences and schedules directly on your Computer.

How to over USB


## Interfaces

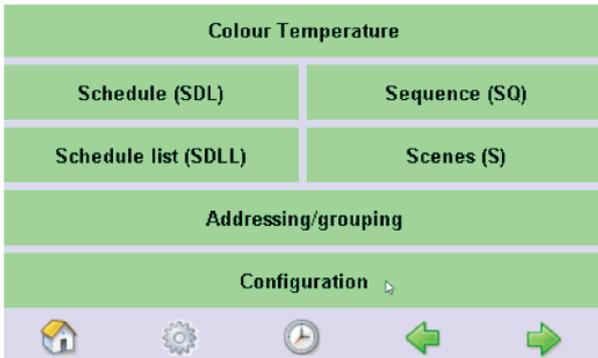

Go to main menu, select Configuration

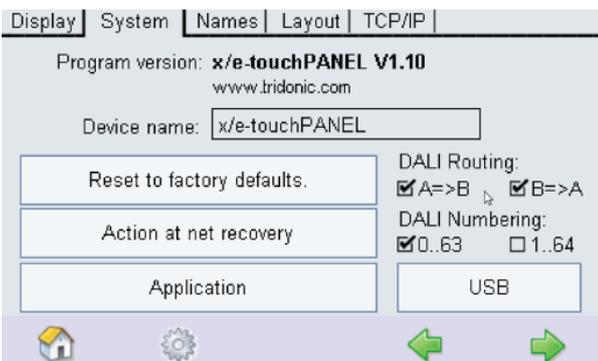

Go to System and select USB

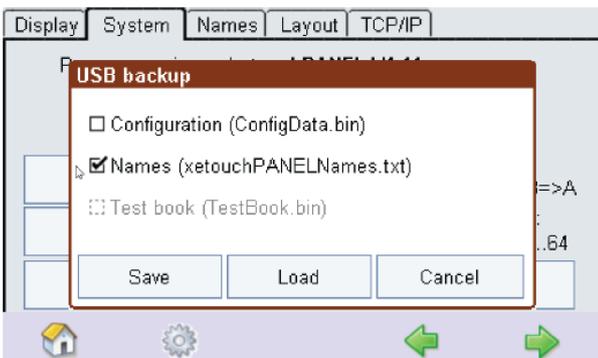

Select Names and then Save.

Now the file xetouchPANELNames.txt will be downloaded to your USB.

To restore the data select Load.

## Interfaces

### 7.4. Ethernet interface

A network cable is required to connect the x/e-touchPANEL to a PC/laptop via Ethernet.

To establish a network connection to a x/e-touchPANEL, each x/e-touchPANEL must be assigned an individual IP address. If you want to include several x/e-touchPANEL into an existing company network, for example, consult your IT specialist for the IP addresses.


The network address also can be automatically obtained from a DHCP server.

For networks with Firewall, Switch, etc., please also contact your IT specialist.

Apart from calibrating the touchscreen, all functions of the x/e-touchPANEL can be executed with the connected PC/laptop via Ethernet.

#### 7.4.1. Network connection


The following figure shows an example of how several panels can be integrated in one network.

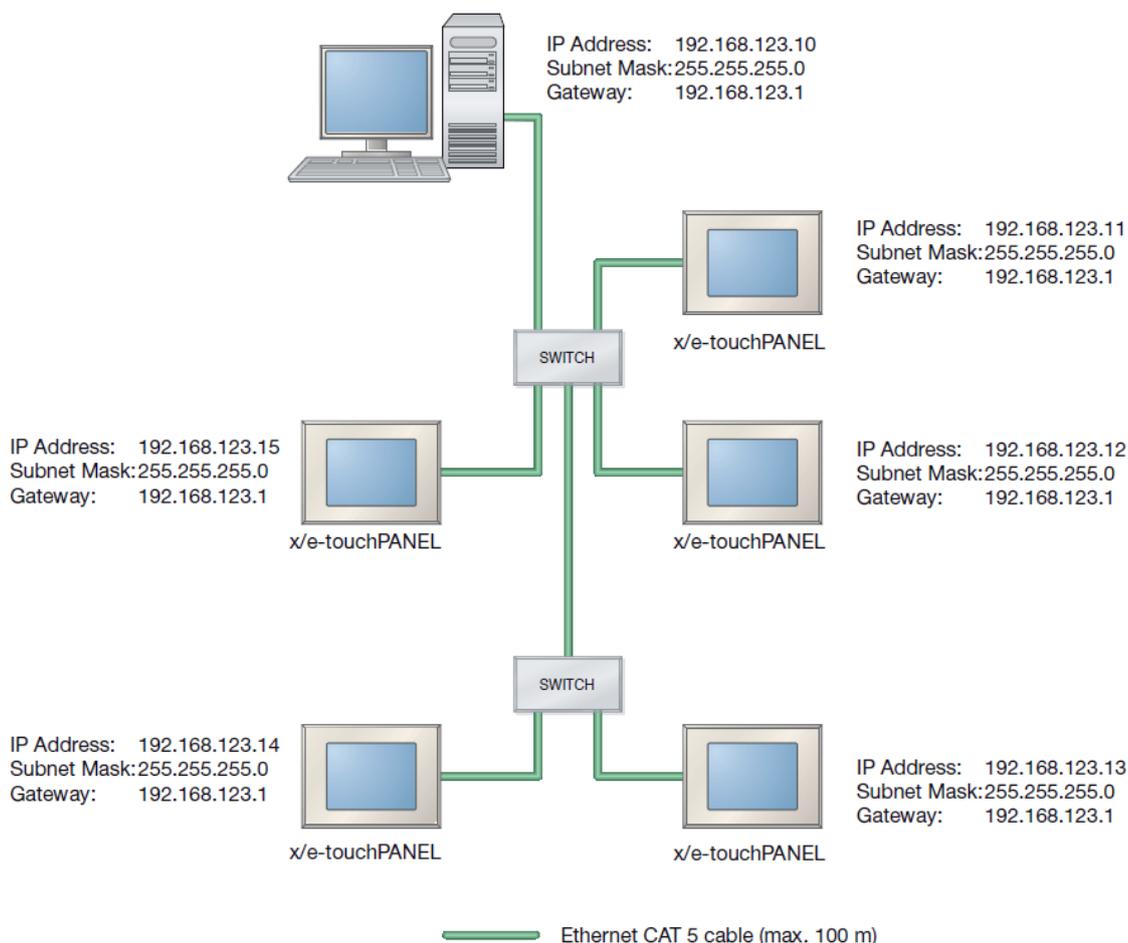

#### 7.4.2. Point-to-point connection

If a point-to-point connection is to be established, a crossed network cable must be used.


## Interfaces

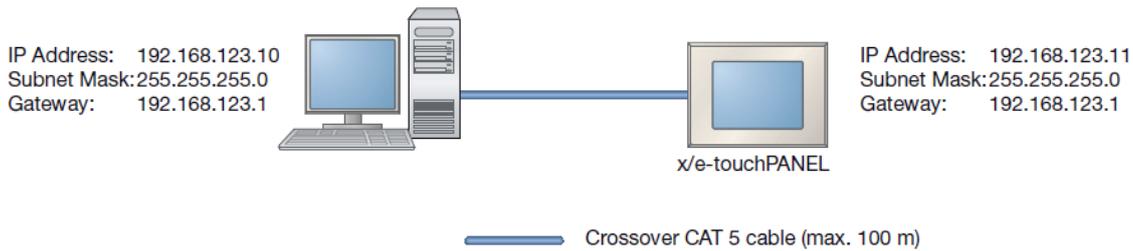


### 7.4.3. Setting an IP address on the x/e-touchPANEL

The Configuration is selected.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed.
2. Click on the "Configuration" button.  
-> The "Configuration" page is displayed.
3. Click on the "TCP / IP" tab  
-> The "TCP / IP" tab is displayed.

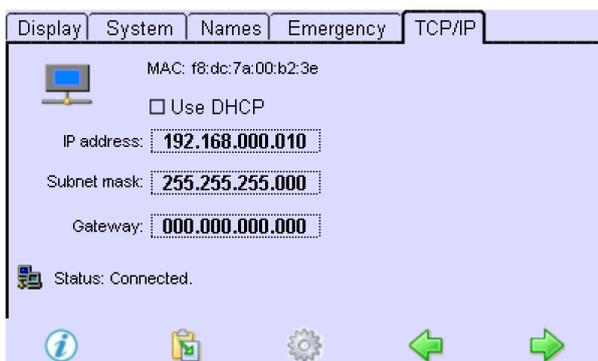

4. Click on "IP address".  
-> The dialog box IP picker is displayed.

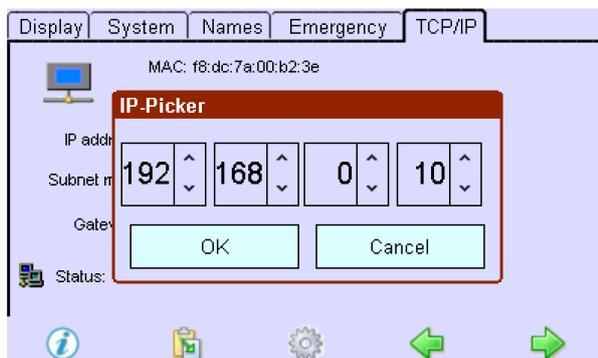

5. Set the IP address using the arrow keys and confirm with OK.
6. Repeat steps 2 and 3 to set Subnet Mask and Gateway.
7. Click on the "Main menu" symbol.

## Interfaces

-> The IP address is saved to the x/e-touchPANEL.

### 7.4.4. Setting an IP address for a network with several x/e-touchPANEL

To establish an Ethernet connection to the x/e-touchPANEL in a network, each panel must be assigned an individual IP address. The »Network connection« diagram shows an example of an addressing process, see "[Ethernet interface](#), p. 97".

#### **i** NOTICE

Please refer to the Help menu or to your operating system's manual on how to assign a permanent IP address. The previous chapter explains how to set the IP address in the x/e-touchPANEL, see "[Network connection](#), p. 97".

#### **i** NOTICE

For PCs / laptops with Firewall or other protection software, please contact your IT specialist.

1. Connect the PC/laptop and the x/e-touchPANEL via the network switch using network cables.
2. On the PC/laptop, the following values must be set for the network card to which the switch for the x/e-touchPANEL is connected:
  - IP address:192.168.123.10
  - Subnet mask: 255.255.255.0
  - Gateway: 192.168.123.1
3. Set the following values for the first x/e-touchPANEL:
  - IP address:192.168.123.11
  - Subnet mask: 255.255.255.0
  - Gateway: 192.168.123.1
4. Set the following values for the second x/e-touchPANEL:
  - IP address:192.168.123.12
  - Subnet mask: 255.255.255.0
  - Gateway: 192.168.123.1
5. Increase the last digit of the IP address if you want to set further x/e-touchPANEL. 255 is the highest possible number.
6. To store the IP address in the x/e-touchPANEL, click on the Main menu symbol.
  - > The x/e-touchPANEL can be controlled via remote control using a web browser with Java Applet installed.

### 7.4.5. Setting an IP address for point-to-point connections

A crossed network cable is required for a point-to-point connection of a x/e-touchPANEL to a PC / Laptop.

#### **i** NOTICE

Please refer to the Help menu or to your operating system's manual on how to assign a permanent IP address. The previous chapter explains how to set the IP address in the x/e-touchPANEL, see "[Setting an IP address on the x/e-touchPANEL](#) , p. 98".

## Interfaces

### **i** NOTICE

For PCs / laptops with Firewall or other protection software, please contact your IT specialist.

1. Connect the x/e-touchPANEL to the PC/laptop using a crossed network cable.
2. Set the following values on the PC/laptop for the network card to which the x/e-touchPANEL is connected:  
IP Address: 192.168.123.10  
Subnet mask: 255.255.255.0  
Gateway: 192.168.123.1
3. Set the following values for the x/e-touchPANEL:  
IP Address: 192.168.123.11  
Subnet mask: 255.255.255.0  
Gateway: 192.168.123.1
4. To store the IP address in the x/e-touchPANEL, click on the Main menu symbol.  
-> The x/e-touchPANEL can be controlled via remote control using a web browser with Java Applet installed.

### 7.4.6. Establishing a connection to the x/e-touchPANEL


The remote control of the x/e-touchPANEL is based on an HTML page with Java-Applet.

In order to operate the x/e-touchPANEL on a PC/laptop, the ›Java Runtime Environment (JRE)‹ must be installed on the PC/laptop (www.java.com). A standard web browser is used for the connection (e.g. ›MS Explorer‹, ›Firefox‹).

Webbrowser is open.

›Java Runtime Environment‹ is installed.

1. Enter the IP address of the x/e-touchPANEL in the address field and confirm with the Enter key

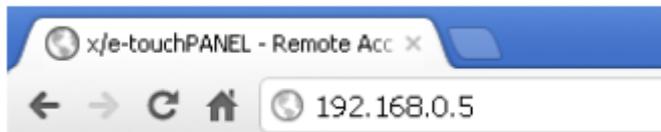

-> The x/e-touchPANEL appears in the browser and can be operated and configured using the mouse pointer and keyboard.

-> In addition, the links get last test, get complete testbook and more... are displayed, see "Uploading/downloading files and test protocols, p. 100".

### 7.5. Uploading / downloading files and test protocols

You can download files to a PC/laptop or upload files from a PC/laptop to the x/e-touchPANEL via Ethernet.

## Interfaces


### **i** NOTICE

A security enquiry informs you that the x/e-touchPANEL will be reset after uploading a configuration file. No test protocols are deleted during resetting.


### 7.5.1. Downloading configuration file and/or testbook

x/e-touchPANEL is connected via the Ethernet interface.

1. Click the link "more..." at bottom of the page.

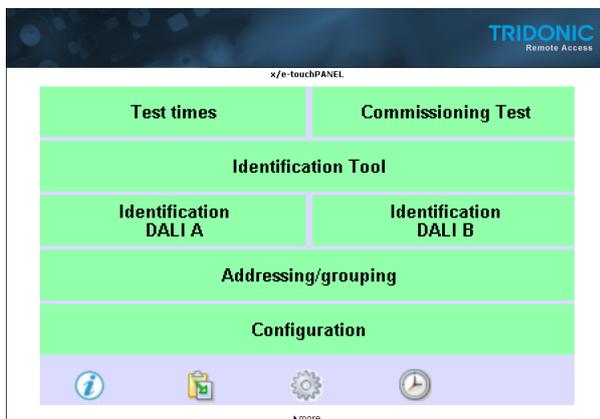

-> Page "File Up/Download" is displayed.

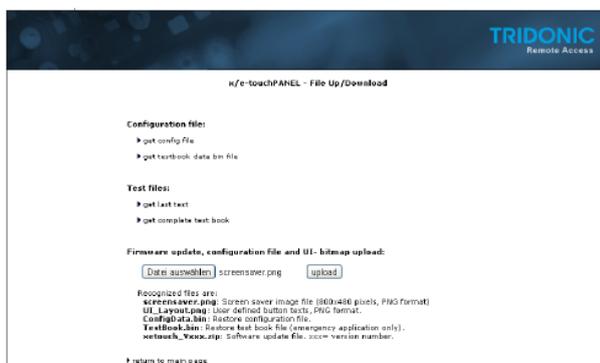


2. Click link "get config file" to download configuration file from x/e-touchPANEL:  
-> Configuration file is saved to PC / Laptop.

### 7.5.2. Download test protocol

x/e-touchPANEL is connected via the Ethernet interface.

1. Click the link "more..." at the bottom of the page.

## Interfaces

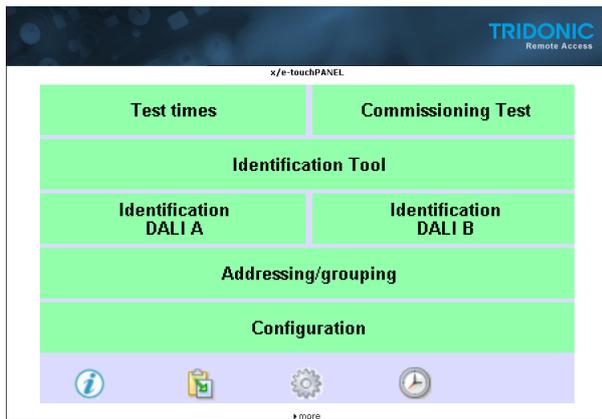

-> Page "File Up/Download" is displayed.



2. Click "get last test" to show all last tests from all devices.

- or -

Click "get complete testbook" to show all tests from all devices.

-> Page "File Up/Downlad" is displayed.

-> Test protocol entries are displayed:

## Interfaces

```

*****
All Test Protocol Entries
x/e-touchPANEL
*****

A6 (G1)    ?
  FT, wed, 11.07.2012 20:46: OK
  DALI EmMode: 0x82
  DALI FailureStatus: 0x00
  DALI EmStatus: 0x22
A5 (G6)    ?
  FT, wed, 11.07.2012 20:46: OK
  DALI EmMode: 0x82
  DALI FailureStatus: 0x00
  DALI EmStatus: 0x02
A4 (G5)    ?
  FT, wed, 11.07.2012 20:46: ERROR
  Battery Failure
  DALI EmMode: 0x82
  DALI FailureStatus: 0x44
  DALI EmStatus: 0x02
A3 (G4)    ?
  FT, wed, 11.07.2012 20:46: OK
  DALI EmMode: 0x82
  DALI FailureStatus: 0x00
  DALI EmStatus: 0x02
A2 (G3)    ?
  FT, wed, 11.07.2012 20:46: OK
  DALI EmMode: 0x82
  DALI FailureStatus: 0x00
  DALI EmStatus: 0x02
A1 (G2)    ?
  FT, wed, 11.07.2012 20:46: OK
  DALI EmMode: 0x82
  DALI FailureStatus: 0x00
  DALI EmStatus: 0x02

```

### 7.5.3. Uploading a screen saver

#### **i** NOTICE

The xetouch software is case sensitive. Pay attention to correct spelling.

Example screensaver:



Correct spelling	Wrong spelling
screensaver.png	screensaver.PNG

A connection via an Ethernet interface is established.

1. Click the link "more..." in the browser.  
-> The File Up/Download page is displayed.
2. Click on the "Select file" button.  
-> A box is displayed with a request to search for and open the respective file.
3. Search for the folder on the hard drive of the laptops / PC in which you have stored the desired file.

## Interfaces

- Select the file screensaver.png and click on the "Open file" button.  
-> The file that you have selected is uploaded and the following box is displayed.

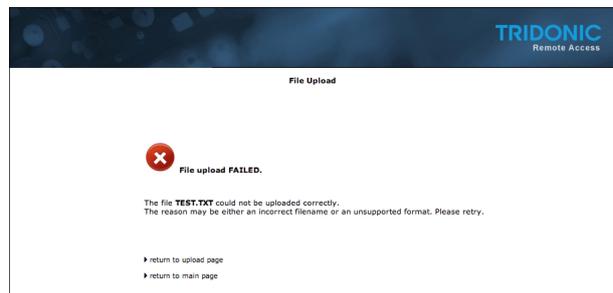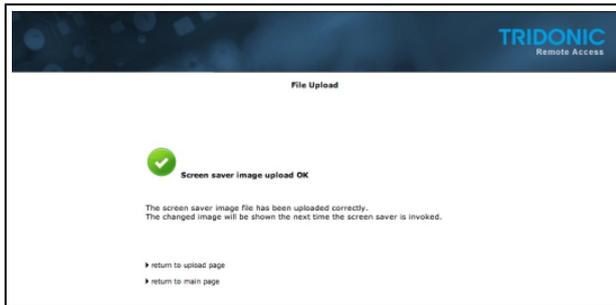

- Click on one of the two links return to upload page or return to main page.  
-> The new screen saver is loaded.

Use the same procedure to change the user interface layout, ConfigData, TestBook or the xetouch software.

Recognized files are:

**screensaver.png**: Screen saver image file (800x480 pixels, PNG format)

**UI\_Layout.png**: User defined button texts, PNG format.

**ConfigData.bin**: Restore configuration file.

**TestBook.bin**: Restore test book file (emergency application only).

**xetouch\_Vxxx.zip**: Software update file. xxx= version number.

### 7.5.4. TA\_mobile Webpage

TA\_mobile Webpage gives you the possibility to control Light from Android and Apple devices over WLAN.

This page can be edited and customised.

#### Supported Commands

Goto Scene1-16

OFF

DAPxxx (0-255)

UP

Down

Startsequenz

Stopsequenz

Resetsequenz


Grup 1-16

(Grup not supported for scene- commands)

**!To be able to use this Function the x/e-touchPANEL has to be connected to Ethernet and you router needs WLAN.**

#### How to

## Interfaces

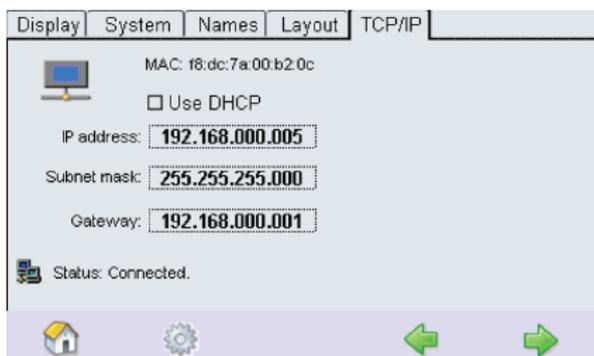

Connect your x/e-touchPANEL to Ethernet.


Type the IP address followed by /TAmobile.htm in your Web Browser



**! Attention The xetouch software is case sensitive. Pay attention to correct spelling.**


You will see the TA\_mobile Webpage.

On this Page you can recall Scene 1-3 and Switch the lights off.

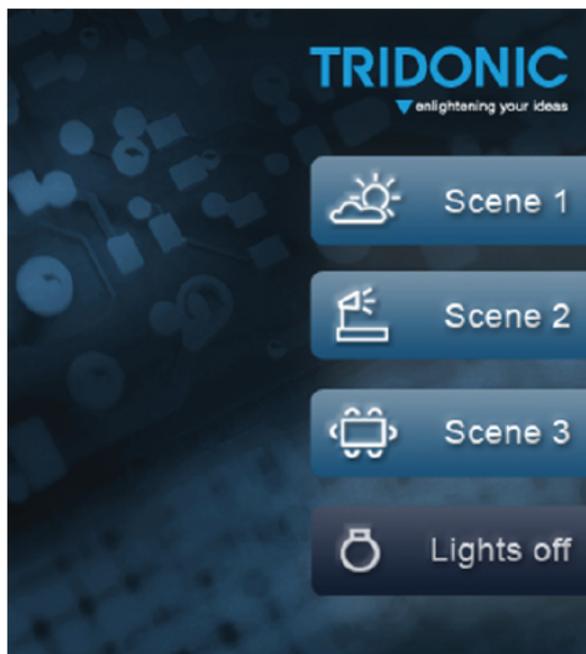

How to Editing the page example Google Chrome

# Interfaces

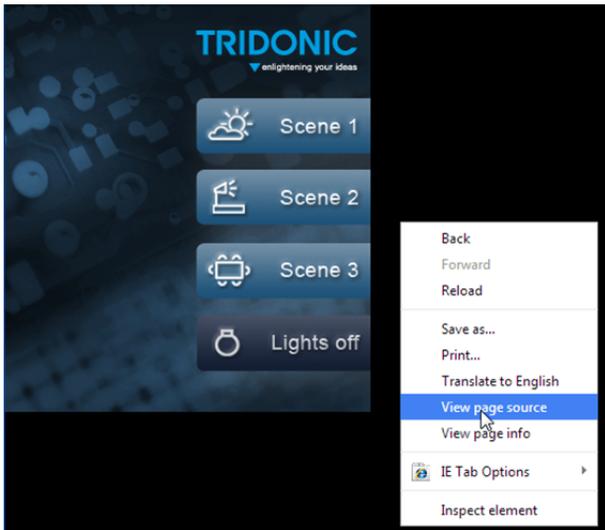

Right click in the black area and select view page source.

```
<!DOCTYPE html PUBLIC "-//WAPFORUM//DTD XHTML Mobile 1.0//EN" "http://www.wapforum.org/DTD/xhtml-mobile10.dtd">
<html xmlns="http://www.w3.org/1999/xhtml">
<head>
<meta http-equiv="Content-Type" content="text/html; charset=utf-8" />
<meta http-equiv="cache-control" content="no-cache">
<meta http-equiv="pragma" content="no-cache">
<title>x-touchPANEL</title>
<style type="text/css">
<!--
body,td,th {
font-family: Arial, Helvetica, sans-serif;
color: #FFFFFF;
}
body {
background-color: #000000;
margin-left: 0px;
margin-top: 0px;
margin-right: 0px;
margin-bottom: 0px;
}
-->
</style></head>
<body>


<map name="Map" id="Map">
<area shape="rect" coords="39,24,283,59" href="http://www.tridonicatoo.com" alt="Tridonic@too" />
<area shape="rect" coords="163,82,320,132" href="TAmobile.htm?action=scene1" alt="Scene 1"/>
<area shape="rect" coords="163,145,320,196" href="TAmobile.htm?action=scene2" alt="Scene 2"/>
<area shape="rect" coords="163,210,320,260" href="TAmobile.htm?action=scene3" alt="Scene 3"/>
<area shape="rect" coords="163,274,320,323" href="TAmobile.htm?action=off" alt="Lights off"/>
<!--
List of all supported commands:
?action=scene1 .... ?action=scene16
?action=off
?action=DimMax [0..255]
?action=up
?action=dn
?action=resetseq
?action=stopseq
?action=resetseq
?action=resetseq (if &group is omitted the command is sent broadcast)
&group=xx [1..16] ( &group not supported for scene- commands)
e.g.: send direct arc power 200 to group5 ?action=DAP200&group=5
send group5 DOWN ?action=dn&group=5
-->
</map>
</body>
</html>
```

You will see the source code.


```
<meta http-equiv="Content-Type" content="text/html; charset=utf-8" />
<meta http-equiv="cache-control" content="no-cache">
<meta http-equiv="pragma" content="no-cache">
<title>x-touchPANEL</title>
<style type="text/css">
<!--
body,td,th {
font-family: Arial, Helvetica, sans-serif;
color: #FFFFFF;
}
body {
background-color: #000000;
margin-left: 0px;
margin-top: 0px;
margin-right: 0px;
margin-bottom: 0px;
}
-->
</style></head>
<body>

<map name="Map" id="Map">
<area shape="rect" coords="39,24,283,59" href="http://www.tridonicatoo.com" alt="Tridonic@too" />
<area shape="rect" coords="163,82,320,132" href="TAmobile.htm?action=scene1" alt="Scene 1"/>
<area shape="rect" coords="163,145,320,196" href="TAmobile.htm?action=scene2" alt="Scene 2"/>
<area shape="rect" coords="163,210,320,260" href="TAmobile.htm?action=scene3" alt="Scene 3"/>
<area shape="rect" coords="163,274,320,323" href="TAmobile.htm?action=off" alt="Lights off"/>
<!--
List of all supported commands:
?action=scene1 .... ?action=scene16
?action=off
?action=DimMax [0..255]
?action=up
?action=dn
?action=resetseq
?action=stopseq
?action=resetseq
?action=resetseq (if &group is omitted the command is sent broadcast)
&group=xx [1..16] ( &group not supported for scene- commands)
e.g.: send direct arc power 200 to group5 ?action=DAP200&group=5
send group5 DOWN ?action=dn&group=5
-->
</map>
</body>
</html>
```

Right click and select Save as




Select save as type: Webpage, HTML Only

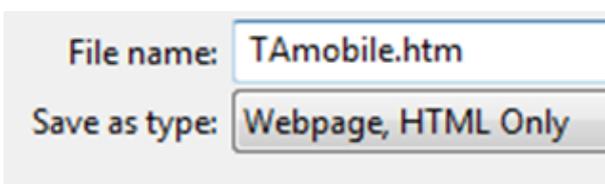

Rename the File to TAmobile.htm and save it.

# Interfaces

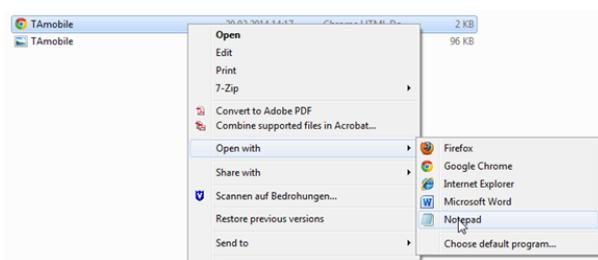

Open the file with Notepad.


Now you can edit the functions.

## How to customise the TA\_mobile webpage Explained with the Field Scene 1

```
<body>

<map name="Map" id="Map">
<area shape="rect" coords="39,24,283,59" href="http://www.tridonicatoo.com" alt="TridonicAtoo" />
<area shape="rect" coords="163,82,320,132" href="TAmobile.htm?action=scene1" alt="Scene 1"/>
</map>
```

In the source code you can see the position and command for Scene 1

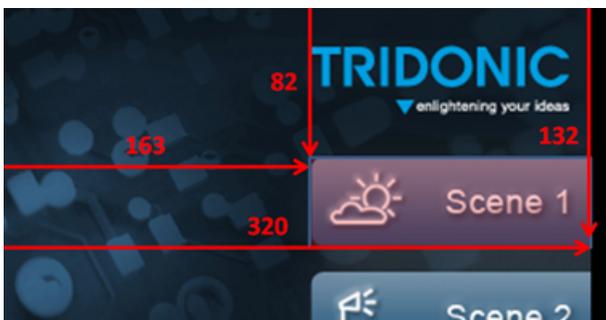


coords="163,82,320,132" is the Field Position.

Now you can change the Command,

or the coordinates for Field Scene1, in the source code.

## Example customised TA\_mobile

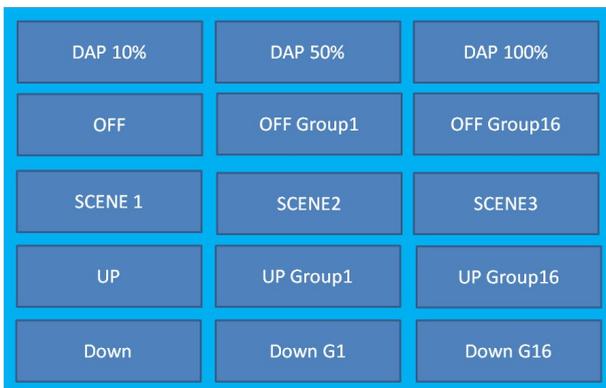

Here you can see a customised TA\_mobile graphic.

Each field has a different command.

Save the Graphic as

TAmobile.jpg

**! Attention The xetouch software is case sensitive. Pay attention to correct spelling.**


Here you can see the source code

```
<body>

<map name="Map" id="Map">
<area shape="rect" coords="24,18,294,109" href="TAmobile.htm?action=DAP10" alt="10%"/>
<area shape="rect" coords="24,126,294,216" href="TAmobile.htm?action=off" alt="OFF"/>
<area shape="rect" coords="24,241,294,331" href="TAmobile.htm?action=scene1" alt="scene1"/>
<area shape="rect" coords="24,347,294,437" href="TAmobile.htm?action=up" alt="UP"/>
<area shape="rect" coords="24,460,294,551" href="TAmobile.htm?action=down" alt="DOWN"/>
<area shape="rect" coords="317,18,584,109" href="TAmobile.htm?action=DAP22" alt="50%"/>
<area shape="rect" coords="317,126,584,216" href="TAmobile.htm?action=offgroup1" alt="OFF G1"/>
<area shape="rect" coords="317,241,584,331" href="TAmobile.htm?action=scene2" alt="scene2"/>
<area shape="rect" coords="317,347,584,437" href="TAmobile.htm?action=upgroup1" alt="UP G1"/>
<area shape="rect" coords="317,460,584,551" href="TAmobile.htm?action=downgroup1" alt="DOWN G1"/>
<area shape="rect" coords="606,18,876,109" href="TAmobile.htm?action=DAP16" alt="100%"/>
<area shape="rect" coords="606,126,876,216" href="TAmobile.htm?action=offgroup16" alt="OFF G16"/>
<area shape="rect" coords="606,241,876,331" href="TAmobile.htm?action=scene3" alt="scene2"/>
<area shape="rect" coords="606,347,876,437" href="TAmobile.htm?action=upgroup16" alt="UP G16"/>
<area shape="rect" coords="606,460,876,551" href="TAmobile.htm?action=downgroup16" alt="DOWN G16"/>
</map>
```

Save the Source code as TAmobile.htm

# Interfaces

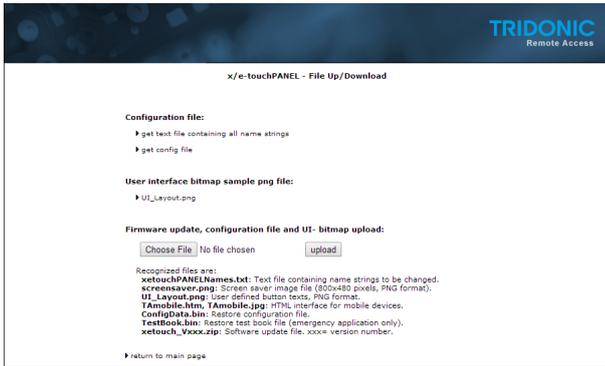


Go to the File Up/Download page and upload the TAmobile.htm and TAmobile.jpg

## 7.5.5. Rename Groups, Scenes, Sequences, Schedules

It is possible to rename groups, scenes, sequences and schedules directly on your Computer.

### How to over Ethernet

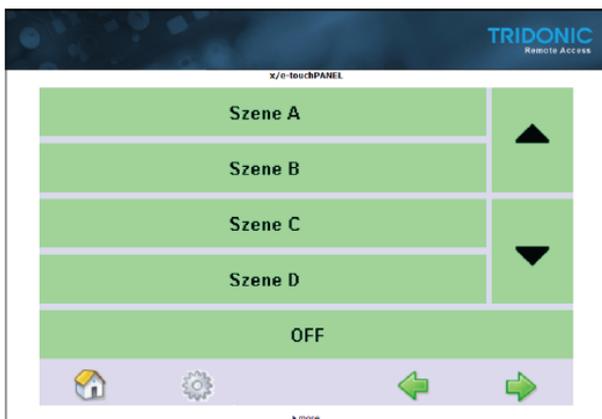

Connect over Ethernet to your x/e-touchPANEL

Select more



to see the File Up/Download Page




Select get text file containing all name strings

# Interfaces

```
<!-- -----
Names file for xetouchPANEL: (BASIC application)
- Edit names and upload changed file to the xetouchPANEL.
- The file can also be placed on an USB stick for update:
  AutoRun/LTUpdate/home/xetouchPANELNames.txt
----- -->
```


```
<!-- Group Names ----- -->
<Groups>
  <G1 name="office1"/>
  <G2 name="office2"/>
  <G3 name="Gruppe C"/>
  <G4 name="Gruppe D"/>
  <G5 name="Gruppe E"/>
  <G6 name="Gruppe F"/>
  <G7 name="Gruppe G"/>
  <G8 name="Gruppe H"/>
  <G9 name="Gruppe I"/>
  <G10 name="Gruppe J"/>
  <G11 name="Gruppe K"/>
  <G12 name="Gruppe L"/>
  <G13 name="Gruppe M"/>
  <G14 name="Gruppe N"/>
  <G15 name="Gruppe O"/>
  <G16 name="Gruppe P"/>
</Groups>

<!-- Scene Names ----- -->
<Scenes>
  <S1 name="Scene A"/>
  <S2 name="Scene B"/>
  <S3 name="Scene C"/>
```



In the new window


Right click and select Save as

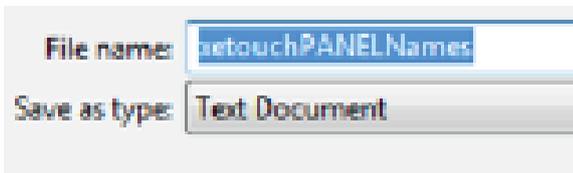

Save the File as

**xetouchPANELNames.txt**

! Attention The xetouch software is case sensitive. Pay attention to correct spelling.

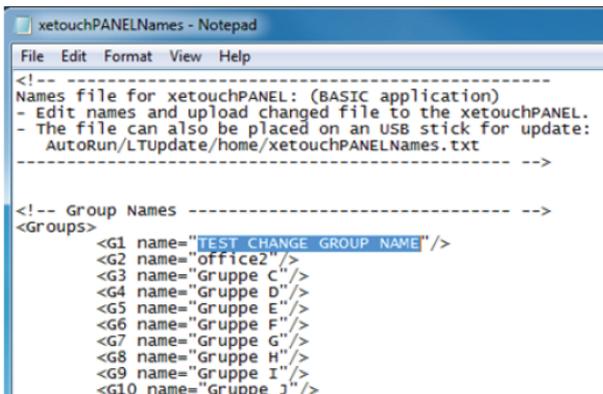

Search and open the saved file (e.g. in Notepad)


Now you can edit the names of

Groups, Scenes, Schedules, Sequences

Each Application has his own template and has to be downloaded separately.

When you have changed the Names save the File

**xetouchPANELNames.txt**

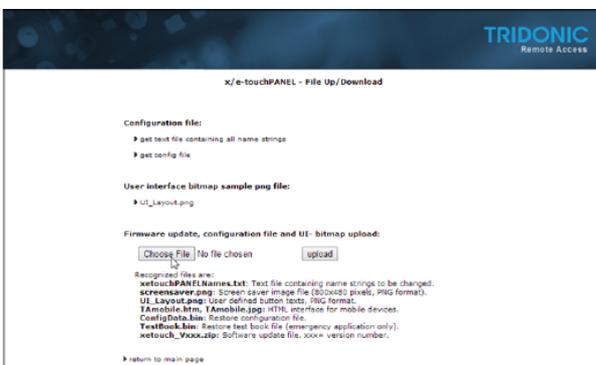

Select choose File on the File Up/Download Page


# Appendix

**Firmware update, configuration file and UI- bitmap upload:**

Select [upload](#).


Choose File xetouchPANELNames.txt

Recognized files are:  
**xetouchPANELNames.txt:** Text file containing name strings to be changed.  
**screensaver.png:** Screen saver image file (800x480 pixels, PNG format).  
**UI\_Layout.png:** User defined button texts, PNG format.  
**TAmobile.htm, TAmobile.jpg:** HTML interface for mobile devices.  
**ConfigData.bin:** Restore configuration file.  
**TestBook.bin:** Restore test book file (emergency application only).  
**xetouch\_Vxxx.zip:** Software update file. xxx= version number.

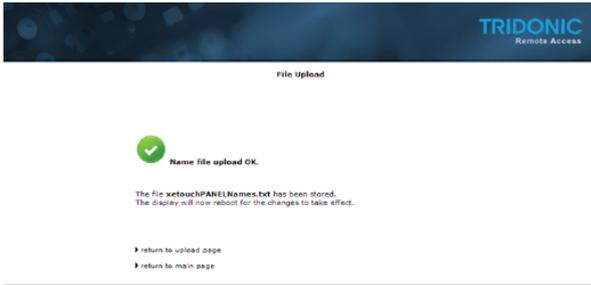

You will then see that the file upload was OK.

Select [return to main page](#)

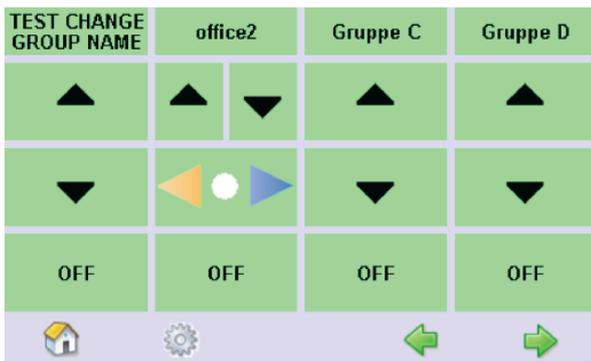

Result

Changed Name of Group 1

## Appendix

### 8.1. Technical data


	x/e-touchPANEL
Article number	28000005
Mains voltage	230/240 V
Mains frequency	50/60 HZ
Power consumption	10 W
Max. output current	-
Interfaces	USB, Ethernet
Bus system	DALI (external bus supply required)
Number of DALI lines	2
Device addresses in EMERGENCY operating mode	60 for each DALI line (120)
Device addresses in the BASIC, COLOUR or PLUG operating mode	64 for each DALI line (128)
Dimensions (L x W x H)	200 x 150 x 20 mm
Permissible ambient temperature	0-50 °C
Weight	0.92 kg
Fastening distance (D)	155 mm
Protection class	IP 20
Protection class	SK I
Screen	Touchpanel (7" / 800 x 480 / 64k colours+)

The x/e-touchPANEL can also be supplied with power by the 8-wire Ethernet cable (Power over Ethernet (PoE)).


## Appendix

### 8.2. Circuit diagrams

#### 8.2.1. Circuit diagram EMERGENCY Application

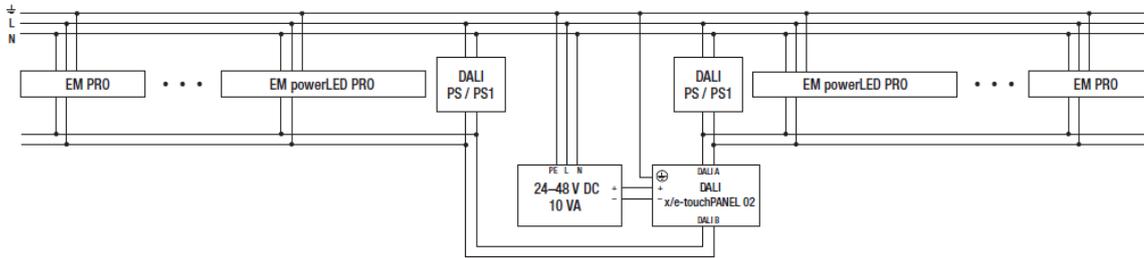

#### 8.2.2. Circuit diagram Basic Colour, Plug Application

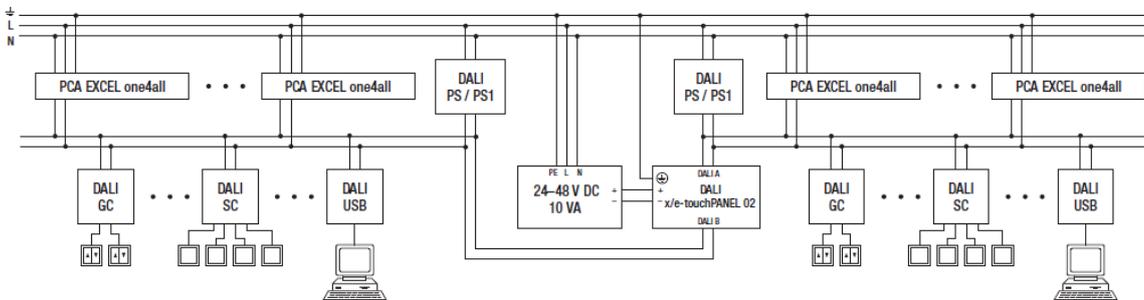

#### NOTICE

The x/e-touchPANEL requires a separate bus supply for each DALI line.

## Appendix

### 8.3. Schedule for Ethernet connections

#### 8.3.1. Name of x/e-touchPANEL

IP Address

---

MAC Address

---

Subnet Mask

---

Default Gateway

---

Annotation

---

#### 8.3.2. Name of x/e-touchPANEL

IP Address

---

MAC Address

---

Subnet Mask

---

Default Gateway

---

Annotation

---

#### 8.3.3. Name of x/e-touchPANEL

IP Address

---

MAC Address

---

Subnet Mask

---

Default Gateway

---

Annotation

---

## Appendix

### 8.3.4. Name of x/e-touchPANEL

IP Address

---

MAC Address

---

Subnet Mask

---

Default Gateway

---

Annotation

---

### 8.3.5. Name of x/e-touchPANEL

IP Address

---

MAC Address

---

Subnet Mask

---

Default Gateway

---

Annotation

---

## Appendix

### 8.4. Help in the case of problems

#### 8.4.1. Reset of settings

All settings can be reset to the factory default values. In this case, the addressing of the emergency units or operating devices is also deleted.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Click on the "Configuration" button  
-> The "Configuration" page is displayed  
Click on the "System" tab  
-> The "System" tab is displayed
3. Click on the "Reset to factory defaults" button.  
-> System is reset to factory defaults.

#### 8.4.2. Ethernet connection cannot be established

- \_ Ensure that a crossed network cable was used for a point-to-point connection (x/e-touchPANEL directly connected to the PC/laptop).
- \_ Ensure that the IP address entered in the x/e-touchPANEL and in the browser is correct, see "[Setting an IP address on the x/e-touchPANEL, p. 98](#)".
- \_ Ensure that no Firewall or protection software is disturbing the connection. If necessary, contact your IT specialist

#### 8.4.3. DALI scenes cannot be defined

##### NOTICE

To configure a scene, only one operating device is to be assigned to a group because otherwise conflicts may occur.

1. Click on the "Main menu" symbol.  
-> The "Main menu" is displayed
2. Ensure that each device is only assigned to one group.
3. Click on the "Addressing/grouping" button.
4. Click on the "Folder" button and check all groups one after another. Ensure that the device is assigned to a group.
5. Change the grouping as required.

## Appendix

### 8.5. Reference list

#### 8.5.1. Related documents

- \_ Data sheet DALI x/e-touchPANEL 02: [http://www.tridonic.com/com/en/download/data\\_sheets/x\\_e-touchPANEL\\_02\\_en.pdf](http://www.tridonic.com/com/en/download/data_sheets/x_e-touchPANEL_02_en.pdf)
- \_ DALI manual: [http://www.tridonic.com/com/en/download/technical/DALI-manual\\_en.pdf](http://www.tridonic.com/com/en/download/technical/DALI-manual_en.pdf)
- \_ Declarations of conformity: <http://www.tridonic.com/com/en/declarations-of-conformity.asp>
- \_ Certificates: <http://www.tridonic.com/com/en/certificates.asp>

#### 8.5.2. Downloads

- \_ Tridonic software: <http://www.tridonic.com/com/en/software.asp>
- \_ x/e-touchPANEL software: <http://www.tridonic.com/com/en/software-x-e-touchpanel.asp>
- \_ em-LINK software: <http://www.tridonic.com/com/en/software-em-link.asp>

#### 8.5.3. Additional information

- \_ Guarantee conditions: <http://www.tridonic.com/com/en/guarantee.asp>
- \_ Data sheets: <http://www.tridonic.com/com/en/data-sheets.asp>
- \_ Environmental declarations: <http://www.tridonic.com/com/en/environmental-declarations.asp>
- \_ Product specifications: <http://www.tridonic.com/com/en/product-specifications.asp>
- \_ Other technical documents: <http://www.tridonic.com/com/en/technical-docs.asp>